


Air Conditioners

Technical Data

Rooftops

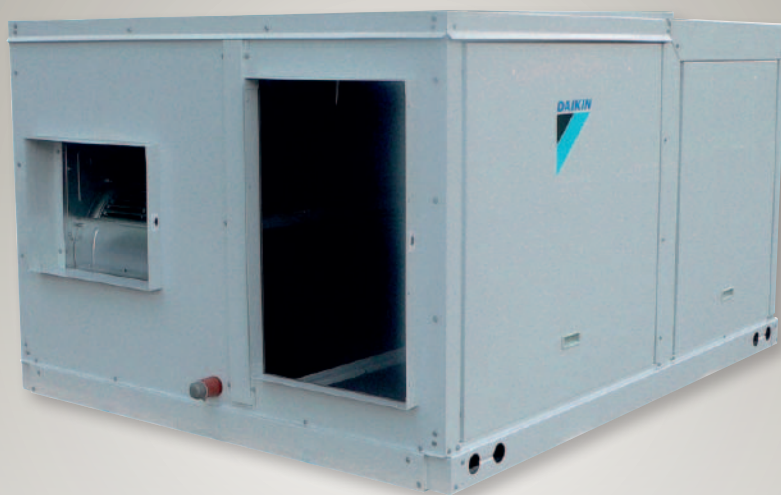

www.daikin.eu

UATYQ250-700BY1

Air Conditioners

Technical Data

Rooftops



www.daikin.eu

UATYQ250-700BY1

TABLE OF CONTENTS

UATYQ-BY1

1	Specification text	2
2	Selection procedure	5
3	Specifications	11
4	Nomenclature	14
5	Safety device settings	15
6	Options	16
7	Capacity tables	17
	Capacity tables cooling	17
	Capacity tables heating	23
8	Dimensional drawing & centre of gravity	25
9	Piping diagram	27
10	Wiring diagram	28
11	Sound data	31
	Sound pressure spectrum	31
	Sound level data	34
12	Fan characteristics	35
13	Installation	37
	Roofcurb drawings	37
	Pulley	38
14	Operation range	40

1 Specification text

UATYQ-BY1

Features Write up

1. **Package Unit:** Daikin's new range of rooftop packaged units has been developed specifically to suit commercial applications and are designed to be easy to install, requiring only ducting (and associated fittings), power/ control wiring and drain piping. Along with the light grey colour, the flat top and compact design gives an aesthetic and neat appearance when installed in line of sight. The unit cabinet is made of powder coated sheet metal especially suitable for outdoor use. All parts of the structure are fastened with corrosion resistant screws and bolts.
2. **Base Beam:** The base beams are fixed and provide a rigid foundation for the entire unit. The beam has the forklift slots and rigging holes for better handling purpose. It is also designed to allow mounting on a roof curb, the dimension of the roof curb should be followed strictly in accordance with the installation manual.
3. **Flexible Air Supply:** Since all the units utilize a belt/ pulley driven supply air fan, the units are able to meet a wide range of supply air volumes and external static pressures. Furthermore, the supply air fan motors, pulleys and belts (field supplied) can be easily changed on site to meet exact air flow and ESP requirement if required.
4. **Convertible Return and Supply Air:** Unit can be easily converted from horizontal to vertical (downward) supply and return air duct configuration by relocating the panels and supply air fan mounting.
5. **Scroll Compressor:** Units are equipped with high efficiency and reliable scroll compressors. Each compressor is mounted on rubber vibration isolators in order to reduce the noise level and vibration transmissions.
6. **Powder Coated Condensate Drain Pan:** The sheet metal condensate drain pan is powder coated to resist corrosion.
7. **Slots for 2 inches Return Air Filters:** A 2 inches rail is provided as standard in instances where a field supplied filter casement need to be installed.
8. **Higher Energy Efficiency Rating:** The UATYQ series is designed in line with market requirement for better energy saving. Its' performance is claimed to be among the best in the market.

1 Specification text

UATYQ-BY1

Technical Write Up:

1. Compressor

Compressor used in UATYQ series Packaged Units are hermetically sealed scroll type. All the compressors are provided with an internal overload protection.

2. Condenser

Condenser coils are manufactured from seamless inner grooved copper tubes mechanically bonded to aluminium fins to ensure optimum heat transfer. All coils are tested against by Nitrogen holding at 609psig and highly precise Helium leak test at 235psig. ALL standard coils are up to 3 rows / 14-16 FPI, 3/8" (9.52mm) O.D. tubes. Hydrophilic Gold Fin coating (NA549) is offered as standard, which has longer life span under corrosive environment.

3. Evaporator

Evaporator coils are manufactured from seamless inner grooved copper tubes mechanically bonded to aluminium fins to ensure optimum heat transfer. All coils are tested against by Nitrogen holding at 609psig and highly precise Helium leak test at 235psig. ALL standard coils are 3-4 rows / 14-16 FPI, 3/8" (9.52mm) O.D. tubes. Hydrophilic Gold Fin coating (NA549) is offered as standard, which has longer life span under corrosive environment.

4. Condenser Fan and Motor

Fans are of propeller type, direct driven by weatherproof electrical induction motors. Condenser fan motor has class F insulation and splash-proof enclosure, IP44.

5. Evaporator Fan and Drive

Blower is DWDI centrifugal, forward curved type. It is mechanically and dynamically balanced and being mounted on a rigid shaft in a self aligned bearing block. The motor is fitted with an adjustable V-belt drive, as standard. It has class B insulation and dripping water proof, IP22.

6. Refrigerant Circuit

Each refrigerant circuit shall have independent electronic expansion devices, HP/ LP switch and refrigerant line service pressure ports as standard factory installed.

7. Expansion device:

Electronic Expansion Valve is being used to ensure accurate control of refrigerant flow.

8. Casing/ Structure

The unit casing used in UATYQ series is made of zinc coated galvanized steel sheets. It is further coated with an electrostatic powder coat and then oven-baked for a tough and lasting weather resistant finish. Zinc plated screws are used throughout to further reduce possibility of unit rusting.

1 Specification text

UATYQ-BY1

9. Insulation

ALL possible areas of condensation to happen are insulated by PE, Polyethelene. Panel insulation is 10mm thickness while drain pan insulation is 5mm thickness.

10. Control

Units shall be completely factory supplied with an integrated controlled Module, with built in resident control algorithms to make decide heating, cooling, or ventilating operations in response to electronic signals from indoor & outdoor temperature sensors.

11. Rooftop Panel - handset

Rooftop Panel comprises all starting, operating and safety controls setting. It is connected to the IC module PCB and supplied as standard.

12. Optional Features

I. 3rd Party Thermostat

For application that requires uniform thermostat outlook with other electrical appliances. 3rd Party thermostat can be connected to the factory supplied module via the contact point available on PCB board.

II. Basic BMS Connection

Unit's standard PCB board provides dry contact for basic BMS connection. Input signal will go to dry contact ON/OFF, COOL/HEAT, and 4 to 20 mA temperature adjuster while output signal will come from ON/OFF, COOL/HEAT, ALARM and DEFROST dry contact.

III. Higher Level BMS Connection

Connection to higher level BMS is possible via Daikin compatible interface, DEC101/102A55.

IV. Economizer

Field installed economizer is supplied from factory as an accessory. It is also designed to cater for horizontal or vertical down throw air discharge orientation.

V. CO2 Sensor

Field specified CO2 sensor can be easily plug on the control board's dry contact, which is come as standard.

2 Selection procedure

Calculation Steps

Interpolation method can be used to get the total capacity, TC and sensible capacity, SC and power input, PI at those temperatures which are not stated out in the table. Extrapolation method are not allowed to be used to get the TC, SC and PI.

Example:

Model: UATYQ450BY1

Indoor Condition: 25°C DB, 17°C WB

Outdoor Condition: 37°C DB

Fan Speed: High (5650CFM)


Solution:

Overall

Based on the Performance Table

1. Refer to the Indoor DB column,
 - **25°C** is located between 24°C and 27°C for 16°CWB (Thus, Interpolation need to be applied)
 - **25°C** is located between 24°C and 27°C for 19°CWB (Thus, Interpolation need to be applied)
2. Refer to the Indoor WB column,
 - **17°C** is located between 16°CWB and 19°CWB for 25°CDB (Thus, Interpolation need to be applied)
3. Refer to the Outdoor DB column,
 - **37°C** is located between 35°C and 40°C. (Thus, Interpolation need to be applied)

Please follow the steps below in order to get the required capacity.

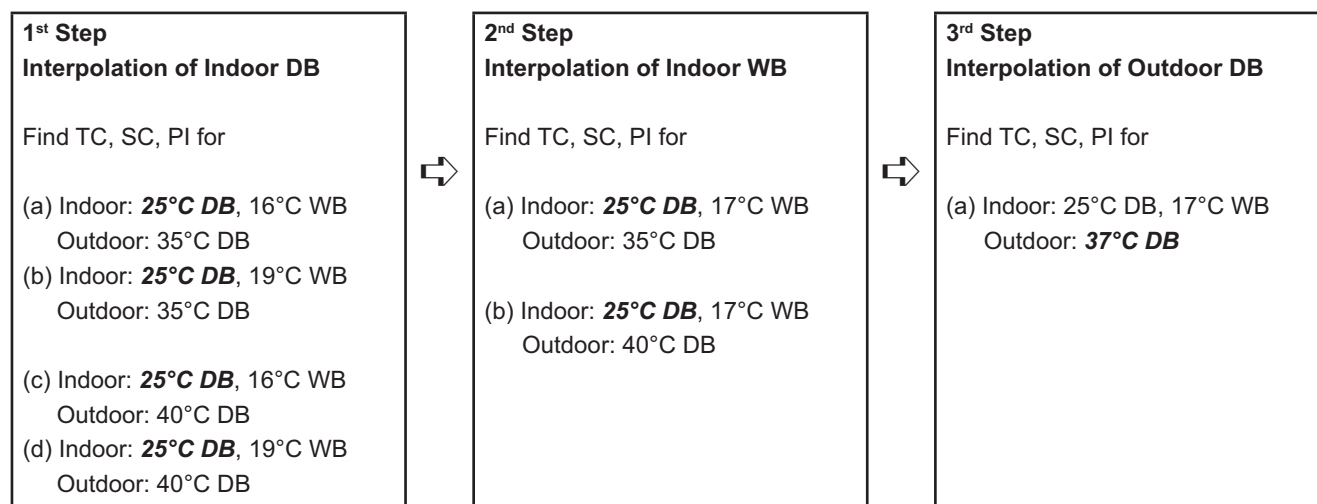

2 Selection procedure

Details:

1st Step:

To obtain the Total capacity and Sensible capacity and Power input for

(a) Indoor Condition: 25°C DB, 16°C WB

Outdoor Condition: 35°C DB

Indoor WB °C	Indoor DB °C	Outdoor DB, °C			
			35		
			TC (kW)	SHC (kW)	PI (kW)
16					
	24		41.41	35.59	12.81
	25		X ₁	Y ₁	Z ₁
	27		43.48	41.63	12.94

Total capacity, TC

Interpolation Method:

$$\Rightarrow \frac{27^{\circ}\text{C} - 24^{\circ}\text{C}}{27^{\circ}\text{C} - 25^{\circ}\text{C}} = \frac{43.48\text{kW} - 41.41\text{kW}}{43.48\text{kW} - x_1\text{kW}}$$

$$\Rightarrow x_1 = 42.10\text{kW}$$

Sensible capacity, SHC

Interpolation Method:

$$\Rightarrow \frac{27^{\circ}\text{C} - 24^{\circ}\text{C}}{27^{\circ}\text{C} - 25^{\circ}\text{C}} = \frac{41.63\text{kW} - 35.59\text{kW}}{43.48\text{kW} - x_1\text{kW}}$$

$$\Rightarrow y_1 = 37.60\text{kW}$$

Power Input, PI

Interpolation Method:

$$\Rightarrow \frac{27^{\circ}\text{C} - 24^{\circ}\text{C}}{27^{\circ}\text{C} - 25^{\circ}\text{C}} = \frac{12.94\text{kW} - 12.81\text{kW}}{12.94\text{kW} - z_1\text{kW}}$$

$$\Rightarrow z_1 = 12.85\text{kW}$$

2 Selection procedure

(b) Indoor Condition: 25°C DB, 16°C WB

Outdoor Condition: 40°C DB

Indoor WB °C	Indoor DB °C	Outdoor DB, °C			
			40		
			TC (kW)	SHC (kW)	PI (kW)
16					
	24		38.59	33.52	13.91
	25		X ₂	Y ₂	Z ₂
	27		40.74	39.20	14.06

Total capacity, TC

Interpolation Method:

$$\Rightarrow \frac{27^{\circ}\text{C} - 24^{\circ}\text{C}}{27^{\circ}\text{C} - 25^{\circ}\text{C}} = \frac{43.48\text{kW} - 41.41\text{kW}}{40.74\text{kW} - x_2\text{kW}}$$

$$\Rightarrow x_2 = 39.31\text{kW}$$

Sensible capacity, SHC

Interpolation Method:

$$\Rightarrow \frac{27^{\circ}\text{C} - 24^{\circ}\text{C}}{27^{\circ}\text{C} - 25^{\circ}\text{C}} = \frac{39.20\text{kW} - 33.52\text{kW}}{39.20\text{kW} - y_2\text{kW}}$$

$$\Rightarrow y_2 = 35.41\text{kW}$$

Power Input, PI

Interpolation Method:

$$\Rightarrow \frac{27^{\circ}\text{C} - 24^{\circ}\text{C}}{27^{\circ}\text{C} - 25^{\circ}\text{C}} = \frac{14.06\text{kW} - 13.91\text{kW}}{14.06\text{kW} - z_2\text{kW}}$$

$$\Rightarrow z_2 = 13.96\text{kW}$$

* Repeat process (a) and (b) in 1st step for the condition below:

(c) Indoor Condition: 25°C DB, 19°C WB

Outdoor Condition: 35°C DB

$$\Rightarrow x_3 = 44.55\text{kW}$$

$$\Rightarrow y_3 = 31.63\text{kW}$$

$$\Rightarrow z_3 = 13.03\text{kW}$$

(c) Indoor Condition: 25°C DB, 19°C WB

Outdoor Condition: 40°C DB

$$\Rightarrow x_4 = 41.46\text{kW}$$

$$\Rightarrow y_4 = 31.63\text{kW}$$

$$\Rightarrow z_4 = 14.13\text{kW}$$

2 Selection procedure

2nd Step:

To obtain the Total capacity, Sensible capacity and Power Input for

(a) Indoor Condition: 25°C DB, 17°C WB

Outdoor Condition: 35°C DB

Indoor WB °C	Indoor DB °C	Outdoor DB, °C			
			35		
			TC (kW)	SHC (kW)	PI (kW)
			⋮	⋮	
16	25		42.10	37.60	12.85
17			X ₅	Y ₅	Z ₅
19			44.55	31.63	13.03

Total capacity, TC

Interpolation Method:

$$\Rightarrow \frac{19^{\circ}\text{C} - 16^{\circ}\text{C}}{19^{\circ}\text{C} - 17^{\circ}\text{C}} = \frac{44.55\text{kW} - 42.10\text{kW}}{44.55\text{kW} - x_5\text{kW}}$$

$$\Rightarrow x_5 = 42.92\text{kW}$$

Sensible capacity, SHC

Interpolation Method:

$$\Rightarrow \frac{19^{\circ}\text{C} - 16^{\circ}\text{C}}{19^{\circ}\text{C} - 17^{\circ}\text{C}} = \frac{31.63\text{kW} - 37.60\text{kW}}{31.63\text{kW} - y_5\text{kW}}$$

$$\Rightarrow y_5 = 35.61\text{kW}$$

Power Input, PI

Interpolation Method:

$$\Rightarrow \frac{19^{\circ}\text{C} - 16^{\circ}\text{C}}{19^{\circ}\text{C} - 17^{\circ}\text{C}} = \frac{13.03\text{kW} - 12.85\text{kW}}{13.03\text{kW} - z_5\text{kW}}$$

$$\Rightarrow z_5 = 12.91\text{kW}$$

2 Selection procedure

(b) Indoor Condition: 25°C DB, 17°C WB

Outdoor Condition: 40°C DB

Indoor WB °C	Indoor DB °C	Outdoor DB, °C			
			40		
			TC (kW)	SHC (kW)	PI (kW)
			⋮	⋮	
16	25		39.31	35.41	13.96
17			X ₆	Y ₆	Z ₆
19			41.46	29.99	14.13

Total capacity, TC

Interpolation Method:

$$\Rightarrow \frac{19^{\circ}\text{C} - 16^{\circ}\text{C}}{19^{\circ}\text{C} - 17^{\circ}\text{C}} = \frac{41.46\text{kW} - 39.31\text{kW}}{41.46\text{kW} - x_6\text{kW}}$$

$$\Rightarrow x_6 = 40.03\text{kW}$$

Sensible capacity, SHC

Interpolation Method:

$$\Rightarrow \frac{19^{\circ}\text{C} - 16^{\circ}\text{C}}{19^{\circ}\text{C} - 17^{\circ}\text{C}} = \frac{29.99\text{kW} - 35.41\text{kW}}{29.99\text{kW} - y_6\text{kW}}$$

$$\Rightarrow y_6 = 33.60\text{kW}$$

Power Input, PI

Interpolation Method:

$$\Rightarrow \frac{19^{\circ}\text{C} - 16^{\circ}\text{C}}{19^{\circ}\text{C} - 17^{\circ}\text{C}} = \frac{14.13\text{kW} - 13.96\text{kW}}{14.13\text{kW} - z_6\text{kW}}$$

$$\Rightarrow z_6 = 14.02\text{kW}$$

2 Selection procedure

3rd Step:

To obtain the Total capacity and Sensible capacity for

(a) **Indoor Condition:** 25°C DB, 17°C WB

Outdoor Condition: 37°C DB

Indoor WB °C	Indoor DB °C	Outdoor DB, °C									
			35			35			40		
			TC (kW)	SHC (kW)	PI (kW)	TC (kW)	SHC (kW)	PI (kW)	TC (kW)	SHC (kW)	PI (kW)
25	17		42.92	35.61	12.91	x	y	z	40.03	33.60	14.02

Total capacity, TC

Interpolation Method:

$$\Rightarrow \frac{40^\circ \text{C} - 35^\circ \text{C}}{40^\circ \text{C} - 37^\circ \text{C}} = \frac{40.03\text{kW} - 42.92\text{kW}}{40.03\text{kW} - x\text{kW}}$$

$$\Rightarrow x = 41.76\text{kW}$$

Sensible capacity, SHC

Interpolation Method:

$$\Rightarrow \frac{40^\circ \text{C} - 35^\circ \text{C}}{40^\circ \text{C} - 37^\circ \text{C}} = \frac{33.60\text{kW} - 35.61\text{kW}}{33.60\text{kW} - y\text{kW}}$$

$$\Rightarrow y = 34.81\text{kW}$$

Power Input, PI

Interpolation Method:

$$\Rightarrow \frac{40^\circ \text{C} - 35^\circ \text{C}}{40^\circ \text{C} - 37^\circ \text{C}} = \frac{14.02\text{kW} - 12.91\text{kW}}{14.02\text{kW} - z\text{kW}}$$

$$\Rightarrow z = 13.35\text{kW}$$

3 Specifications

3-1 General data - Heat pump			UATYQ250BY1	UATYQ350BY1	UATYQ450BY1	UATYQ550BY1	UATYQ600BY1	UATYQ700BY1	
Nominal cooling capacity (Gross)			Btu/h	93300	121400	152600	190000	228000	247700
			W	27340	35580	44720	55690	66820	72600
Nominal heating capacity (Nett)			Btu/h	85000	118700	142600	184000	210500	237500
			W	24910	34790	41790	53930	61690	69610
Nominal total input power (Cooling)			W	8140	10780	13040	16740	19650	21610
Nominal total input power (Heating)			W	7330	10840	12860	15540	18580	21420
Nominal running current (Cooling)			W	16.6	21.2	28.3	30.2	33.8	39.0
Nominal running current (Heating)			W	14.8	20.8	26.9	28.8	32.3	40.2
Power source			V/Ph/Hz	380 ~ 415 / 3 / 50					
Refrigerant type / control			R410A / EXV						
EER (Gross)			W/W	3.36	3.30	3.43	3.33	3.40	3.36
COP (Net)			W/W	3.40	3.21	3.25	3.47	3.32	3.25
Evaporator	Sound power level @ 100 ESP		dBA	68	72	75	82	84	87
	Sound power level @ Std ESP		dBA	73	76	80	84	84	90
	Control	Air discharge	Ducted						
		Operation	Wired						
	Air flow		l/s / cfm	1560 / 3300	2030 / 4300	2670 / 5650	3160 / 6700	3445 / 7300	3917 / 8300
	External static pressure		Pa/in.wg.	147 / 0.6	147 / 0.6	147 / 0.6	206 / 0.8	196 / 0.8	206 / 0.8
	Condensate drain size		mm/in	25.4 / 1	24.4 / 1.0	25.4 / 1	25.4 / 1.0	25.4 / 1	25.4 / 1
Condensor	Air flow		l/s / cfm	3884 / 8230	5664 / 12000	5710 / 1210	6090 / 12900	9534 / 20200	10006 / 21200
	Sound power level		dBA	82	83	83	87	90	90
	Unit dimension	Height	mm/in	1150 / 45.3	1028 / 40.5	1130 / 44.5	1048 / 41.3	1302 / 51.3	1454 / 57.2
		Width	mm/in	1638 / 64.5	2209 / 87.0	2209 / 87.0	2209 / 87.0	2209 / 87.0	2209 / 87.0
		Depth	mm/in	2063 / 53.0	2113 / 83.2	2113 / 83.2	2670 / 105.1	2670 / 105.1	2670 / 105.1
	Packing dimension	Height	mm/in	1345 / 53.0	1223 / 48.1	1325 / 52.2	1252 / 49.3	1506 / 59.3	1674 / 65.9
		Width	mm/in	2321 / 91.4	2372 / 93.4	2304 / 90.7	2304 / 90.7	2304 / 90.7	2304 / 90.7
		Depth	mm/in	1758 / 69.2	2304 / 90.7	2372 / 93.4	2929 / 115.3	2929 / 115.3	2929 / 115.3
	Unit weight (Net)		kg/lb	490 / 1080	660 / 1455	610 / 1345	780 / 1720	830 / 1830	970 / 2139
	Refrigerant charge		kg/lb	6.1 / 13.4	(5.8 x 2) / (12.8 x 2)	(7.2 x 2) / (15.9 x 2)	(8.7 x 2) / (19.2 x 2)	(10.4 x 2) / (22.9 x 2)	(11.6 x 2) / (25.6 x 2)
Notes			All specifications are subjected to change by the manufacturer without prior notice.						
			All units are being tested and comply to ISO 5151.						
			Nominal cooling and heating capacity are based on the conditions below: a) Cooling - 27°C DB / 19°C WB indoor and 35°C DB / 24°C WB outdoor. b) Heating- 20°C DB indoor and 7°C DB / 6°C WB outdoor.						
			Sound pressure levels are measured according to JIS standard.				Sound pressure levels are measured according to JIS B 8616 standard		
			EER/COP calculation is based on effective power input as per ISO 5151.				All performance calculations are strictly following eurovent standard.		

3 Specifications

3-2 Components data - Heat pump				UATYQ250BY1	UATYQ350BY1	UATYQ450BY1	UATYQ550BY1	UATYQ600BY1	UATYQ700BY1
Evaporator fan	Type		Centrifugal forward curve						
	Quantity		1						
	Material		Galvanised steel						
	Drive		Belt drive						
	Diameter	mm/in	381 / 15	381 / 15	381 / 15	400 / 15.7	400 / 15.7	400 / 15.7	
	Length	mm/in	381 / 15	381 / 15	381 / 15	400 / 15.7	400 / 15.7	400 / 15.7	
Evaporator fan motor	Type		Induction motor						
	Quantity		1						
	Index of protection (IP)		IP22						
Condenser fan1	Type		Propeller						
	Quantity		1						
	Material		Plastic						
	Drive		Direct drive						
	Diameter	mm/in	610 / 24.0	681 / 26.8	681 / 26.8	681 / 26.8	800 / 31.5	800 / 31.5	
Condenser fan2	Type		Propeller						
	Quantity		1						
	Material		Plastic						
	Drive		Direct drive						
	Diameter	mm/in	681 / 26.8				800 / 31.5	800 / 31.5	
Condenser fan motor 1	Type		Induction motor						
	Quantity		1						
	Index of protection (IP)		IP44						
Condenser fan motor 2	Type		Induction motor						
	Quantity		1						
	Index of protection (IP)		IP44						
Compressor 1	Type		Scroll						
	Quantity		1						
	Oil type		POE						
	Oil amount	cm³/fl.oz	3253 / 110	1656 / 56	1774 / 60	3253 / 110	3253 / 110	3253 / 110	
Compressor 2	Type		NA	Scroll					
	Quantity		NA	1					
	Oil type		NA	POE					
	Oil amount	cm³/fl.oz	NA	1656 / 56	1774 / 60	3253 / 110	3253 / 110	3253 / 110	
Evaporator coil 1	Tube	Material		S.I.G.C.					
		Diameter	mm/in	9.53 / 3/8					
		Thickness	mm/in	0.35 / 0.014					
	Fin	Material		Aluminium					
		Thickness	mm/in	0.11 / 0.004					
		Face Area	m²/ft²	0.07 / 0.80	0.04 / 0.46	0.51 / 5.49	0.61 / 6.55	0.76 / 8.19	0.91 / 9.82
		Row		3	3	4	4	4	4
		Fin per inch		16	16	14	14	14	14
Evaporator coil 2	Tube	Material		NA	S.I.G.C.				
		Diameter	mm/in	NA	9.53 / 3/8				
		Thickness	mm/in	NA	0.35 / 0.011	0.35 / 0.014	0.35 / 0.014	0.35 / 0.014	0.35 / 0.014
	Fin	Material		NA	Aluminium				
		Thickness	mm/in	0.11 / 0.004					
		Face Area	m²/ft²	NA	0.04 / 0.46	0.51 / 5.49	0.61 / 6.55	0.76 / 8.19	0.91 / 9.82
		Row		NA	3	4	4	4	4
Fin per inch		NA	16	14	14	14	14		
Condenser coil 1	Tube	Material		S.I.G.C.					
		Diameter	mm/in	9.53 / 3/8					
		Thickness	mm/in	0.35 / 0.014					
	Fin	Material		Aluminium					
		Thickness	mm/in	0.11 / 0.004					
		Face Area	m²/ft²	0.12 / 1.28	0.10 / 1.10	1.24 / 13.35	1.33 / 14.34	1.75 / 18.82	2.00 / 21.51
		Row		2	3	3	3	3	3
Fin per inch		16	14	14	14	14	14		

3 Specifications

3-2 Components data - Heat pump				UATYQ250BY1	UATYQ350BY1	UATYQ450BY1	UATYQ550BY1	UATYQ600BY1	UATYQ700BY1
Condenser coil 2	Tube	Material		NA	S.I.G.C.				
		Diameter	mm/in	NA	9.53 / 3/8				
		Thickness	mm/in	NA	0.35 / 0.014				
	Fin	Material		NA	Aliminium				
		Thickness	mm/in	NA	0.11 / 0.004				
		Face Area	m²/ft²	NA	0.10 / 1.10	1.24 / 13.35	1.33 / 14.34	1.75 / 18.82	2.00 / 21.51
		Row		NA	3	3	3	3	3
		Fin per inch		NA	14	14	14	14	14
Air quality	Filter	Type		Washable saranet					
		Quantity	pc	2	2	2	2	2	2
	Filter size	Length	mm/in	880 / 34.65	1126 / 44.3	1126 / 44.33	1497 / 58.9	1497 / 58.9	1497 / 58.9
		Width	mm/in	467 / 18.39	385 / 15.16	435 / 17.16	392 / 15.43	495 / 19.5	595 / 23.43
		Thickness	mm/in	4 / 0.16					
Casing	Material			Electro galvanised mild steel					
	External finishing			Epoxy polyester powder					
	Colour			Light grey					
	Insulation / thickness			PE / 10mm					
Notes				All specifications are subjected to change by the manufacturer without prior notice					
				S.I.G.C. - Seamless Inner Grooved Copper					

3-3 Electrical data - Heat pump			UATYQ250BY1	UATYQ350BY1	UATYQ450BY1	UATYQ550BY1	UATYQ600BY1	UATYQ700BY1
Evaporator motor	Insulation grade		B					
	Power source	V/Ph/Hz	380 ~ 415 / 3 / 50					
	Rated input power	W	800	1160	1910	2580	3130	4220
	Rated running current	A	1.7	3.10	3.7	4.70	5.8	7.8
	Motor Output	W	1100	1500	2200	3000	3700	5500
	Poles		4					
Condenser motor 1	Insulation grade		F					
	Power source	V/Ph/Hz	220 ~ 240 / 1 / 50					
	Rated input power	W	560	870	790	780	1700	1540
	Rated running current	A	2.5	3.8	3.6	3.4	2.9	2.8
	Motor Output	W	360	550	510	590	1200	1200
	Poles		6					
Condenser motor 2	Insulation grade		F					
	Power source	V/Ph/Hz	220 ~ 240 / 1 / 50					
	Rated input power	W	710	870	790	780	1700	1540
	Rated running current	A	3.2	3.8	3.6	3.4	2.9	2.8
	Motor Output	W	420	550	510	590	1200	1200
	Poles		6					
Compressor 1	Insulation grade		F					
	Power Source	V/Ph/Hz	380 ~415 / 3 / 50					
	Capacitor	µF	N/A					
	Rated input power (cooling)	W	7140	4460	5950	7530	8130	9180
	Rated input power (heating)	W	5640	4350	5500	6740	7150	8300
	Rated running current (cooling)	A	13.1	7.9	11.0	13.8	15	16.4
	Rated running current (heating)	A	11.3	7.7	15.0	12.8	14.1	15.6
	Locked rotor amp.	A	111	74	101.0	111	118	118
Compressor 2	Insulation grade		N/A	F				
	Power Source	V/Ph/Hz	N/A	380 ~ 415 / 3 / 50				
	Capacitor	µF	N/A					
	Rated input power (cooling)	W	N/A	4360	5940	7930	8130	9350
	Rated input power (heating)	W	N/A	4160	5180	6920	7150	8510
	Rated running current (cooling)	A	N/A	7.8	11.2	14.1	15	16.7
	Rated running current (heating)	A	N/A	7.5	10.3	13.0	14.1	16
	Locked rotor amp.	A	N/A	74	101.0	111	118	118
Notes			All specifications are subjected to change by the manufacturer without prior notice					
			All units are being tested and comply to ISO 5151					

4 Nomenclature

UATYQ-BY1

UAT Y Q 250 B Y1

Power Supply

Y1: 380-415V, 3ph, 50Hz

Series

B: B series

Capacity

250 kW/10 = 25kW

Refrigerant

Q: R-410A

Model Type

Y = Heat Pump
Blank: Cooling Only

Model name

UAT: Rooftops

5 Safety device settings

UATYQ250-350BY1

Model				UATYQ250BY1	UATYQ350BY1
Safety device	High pressure switch	Type		NC, Auto Reset	
		Open	kPa/psi	4137 / 600	
		Close	kPa/psi	3309 / 480	
	Low pressure switch	Type		NC, Auto Reset	
		Open	kPa/psi	124 / 18	
		Close	kPa/psi	193 / 28	
	Phase sequencer			YES	
	Discharge thermostat setting		°C/°F	120 / 248	

UATYQ450-550BY1

Model				UATYQ450BY1	UATYQ550BY1
Safety device	High pressure switch	Type		NC, Auto Reset	
		Open	kPa/psi	4137 / 600	
		Close	kPa/psi	3309 / 480	
	Low pressure switch	Type		NC, Auto Reset	
		Open	kPa/psi	124 / 18	
		Close	kPa/psi	193 / 28	
	Phase sequencer			YES	
	Discharge Thermostat setting		°C/°F	120 / 248	

UATYQ600-700BY1

Model				UATYQ600BY1	UATYQ700BY1
Safety device	High pressure switch	Type		NC, Auto Reset	
		Open	kPa/psi	4137 / 600	
		Close	kPa/psi	3309 / 480	
	Low pressure switch	Type		NC, Auto Reset	
		Open	kPa/psi	124 / 18	
		Close	kPa/psi	193 / 28	
	Phase sequencer			YES	
	Discharge thermostat setting		°C/°F	120 / 248	

6 Options

UATYQ-BY1

Model		Classification										
		Roofop controller	PCB	EXV	Gold Fin (NA549)	Scroll compressor	Saranet Air Filter	Side flow	Convertible	Filter Drier	High pressure switch	Low pressure switch
UATYQ-BY1	250	X	X	X	X	X	X	X	X	X	X	X
	350	X	X	X	X	X	X	X	X	X	X	X
	450	X	X	X	X	X	X	X	X	X	X	X
	550	X	X	X	X	X	X	X	X	X	X	X
	600	X	X	X	X	X	X	X	X	X	X	X
	700	X	X	X	X	X	X	X	X	X	X	X

Remarks: Economizers & CO2 sensor will be ready soon.

Capacity tables

7 - 1 Capacity tables cooling

UATYQ250BY1

AFR (CFM)	EWB	EDB	Outdoor temperature																	
			19°C			25°C			30°C			35°C			40°C			46°C		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
2640	16°C	21°C	26.92	17.79	6.55	25.90	17.33	6.93	25.31	17.19	7.46	24.12	16.64	7.91	22.42	15.75	8.60	50.86	15.04	9.52
		24°C	27.02	20.73	6.56	26.00	20.27	6.94	25.41	20.17	7.47	24.23	19.64	7.92	22.60	18.55	8.61	21.16	17.59	9.54
		28°C	27.60	25.41	6.58	26.65	24.72	6.97	26.15	24.48	7.51	25.07	26.64	7.97	23.52	22.40	8.67	22.18	21.23	9.62
		30°C	28.31	28.31	28.31	6.65	27.43	27.43	7.05	26.49	7.60	25.49	25.49	8.08	23.92	23.92	8.78	22.61	22.61	9.72
	19°C	24°C	29.44	16.79	6.69	28.30	16.35	7.08	27.67	16.22	7.61	26.39	15.74	8.07	24.56	14.94	8.76	22.90	14.29	9.68
		27°C	29.52	20.66	6.70	28.39	20.20	7.09	27.75	20.12	7.62	26.48	19.60	8.08	24.65	18.68	8.76	23.00	18.02	9.59
		30°C	29.67	24.23	6.71	28.66	23.57	7.10	28.13	23.34	7.64	26.94	22.58	8.11	25.20	21.36	8.80	23.69	20.39	9.74
		33°C	30.23	30.23	6.75	28.93	28.93	7.15	29.12	29.12	7.71	28.05	28.05	8.18	25.58	25.58	8.89	24.48	24.48	9.84
	22°C	27°C	31.94	16.47	6.85	30.87	16.13	7.25	30.19	16.01	7.79	28.81	15.54	8.25	26.84	14.76	8.93	25.10	14.19	9.86
		30°C	32.17	20.48	6.86	30.94	250.03	7.25	30.25	19.95	7.79	28.89	19.46	8.25	26.91	18.57	8.94	25.16	17.95	9.86
		33°C	32.25	24.19	6.86	31.02	23.73	7.26	30.32	23.72	7.80	28.97	23.22	8.26	27.10	21.99	8.96	25.53	21.02	9.89
		36°C	32.40	26.87	6.89	31.28	26.17	7.29	30.91	26.12	7.84	29.66	25.35	8.31	27.94	24.19	9.02	26.43	23.19	9.96
16°C	21°C	27.89	18.62	6.60	26.78	18.12	6.98	26.14	17.97	7.51	24.90	17.42	7.97	23.11	16.51	8.65	21.47	15.80	9.57	
	24°C	28.06	22.96	6.62	27.05	22.29	7.00	26.49	22.00	7.54	25.32	21.22	7.99	23.59	19.99	8.68	22.07	18.98	9.61	
	28°C	29.12	26.80	6.67	28.17	26.05	7.07	27.69	25.74	7.61	26.58	24.83	8.08	24.90	23.38	8.78	23.45	22.13	9.72	
	30°C	30.19	30.19	6.77	29.19	29.19	7.17	28.15	28.15	7.72	27.06	27.06	8.20	25.10	25.10	8.90	23.69	23.69	9.84	
3300	19°C	24°C	30.42	18.53	6.75	29.22	18.04	7.14	28.53	17.90	7.67	27.19	17.36	8.13	25.27	16.47	8.81	23.53	15.79	9.73
		27°C	30.57	22.98	6.76	29.37	22.49	7.15	28.69	22.42	7.68	27.34	21.87	8.14	25.50	20.72	8.83	23.88	19.68	9.76
		30°C	31.20	26.32	6.79	30.07	25.60	7.19	29.48	25.35	7.74	28.23	24.56	8.20	26.44	23.20	8.90	24.97	22.02	9.84
		33°C	31.86	31.86	6.87	30.85	30.85	7.28	29.77	29.77	7.84	28.63	28.63	8.32	26.87	26.87	9.03	25.43	25.43	9.97
	22°C	27°C	33.11	18.28	6.91	31.80	17.84	7.31	31.07	17.74	7.85	29.63	17.22	8.31	27.56	16.35	9.00	25.73	15.70	9.91
		30°C	33.22	22.84	6.92	31.92	22.36	7.32	31.19	22.30	7.86	29.75	21.77	8.32	27.69	20.80	9.01	25.88	20.15	9.92
		33°C	33.46	27.07	6.94	32.26	26.33	7.34	31.64	26.07	7.89	30.30	25.24	8.36	28.32	23.90	9.06	26.66	22.87	9.99
		36°C	34.08	29.22	6.99	32.88	28.63	7.39	32.05	28.12	7.96	30.87	27.22	8.44	28.71	25.44	9.16	26.93	23.98	10.11
	16°C	21°C	28.55	20.03	6.64	27.41	19.53	7.02	26.74	19.37	7.55	25.45	18.80	8.01	23.61	17.83	8.69	21.92	17.08	9.60
		24°C	29.05	24.35	6.67	27.95	23.62	7.06	27.35	23.32	7.59	26.12	22.50	8.05	24.34	21.22	8.74	22.83	20.03	9.67
		28°C	30.46	28.03	6.75	29.39	27.18	7.14	28.90	26.86	7.69	27.71	25.88	8.16	25.94	24.35	8.86	24.39	23.02	9.80
		30°C	31.28	31.28	6.85	30.22	30.22	7.26	29.11	29.11	7.82	27.95	27.95	8.29	26.31	26.31	8.99	24.55	24.55	9.93
3960	19°C	24°C	31.12	19.98	6.79	29.87	19.47	7.18	29.13	19.32	7.72	27.73	18.76	8.17	25.77	17.83	8.85	24.00	17.13	9.77
		27°C	31.33	25.03	6.81	30.11	24.43	7.20	29.49	24.14	7.74	28.17	23.28	8.20	26.26	21.96	8.89	24.60	20.89	9.81
		30°C	32.28	27.64	6.86	31.18	26.95	7.26	30.65	26.63	7.82	29.43	25.69	8.29	27.58	24.20	8.99	26.01	22.94	9.93
		33°C	33.03	33.03	6.97	31.95	31.95	7.38	31.12	31.12	7.94	29.92	29.92	8.42	28.06	28.06	9.13	26.23	26.23	10.07
	22°C	27°C	33.81	19.81	6.96	32.47	19.31	7.35	31.68	19.18	7.90	30.17	18.63	8.35	28.08	17.73	9.04	26.22	17.07	9.95
		30°C	34.00	24.92	6.97	32.65	24.41	7.37	31.86	24.37	7.91	30.36	23.82	8.37	28.30	22.72	9.05	26.55	21.64	9.98
		33°C	34.64	28.87	7.01	33.36	28.08	7.41	32.68	27.82	7.96	31.30	26.96	8.43	29.24	25.53	9.13	27.65	24.26	10.07
		36°C	35.21	30.28	7.08	33.71	29.13	7.50	33.22	28.86	8.08	31.96	27.90	8.56	29.70	26.06	9.27	28.12	24.80	10.22

NOTES - ANMERKUNGEN - ΣΗΜΕΙΩΣΕΙΣ - NOTAS - REMARQUES - NOTE - OPMERKINGEN - ПРИМЕЧАНИЯ - NOTLAR

- Ratings shown are gross capacities which do not include a deduction for indoor fan motor heat. - Die Nennwerte sind Bruttoleistungen, die keine Abzüge für die Motorwärme der Innenventilatoren enthalten. - Οι τιμές που αναφέρονται αντιπροσωπεύουν μικτή απόδοση, χωρίς κάποια μικρή απόκλιση που αντιστοιχεί στη θέρμανση του κινητήρα του ανεμιστήρα της εσωτερικής μονάδας. - Los valores indicados son capacidades brutas a las que no se ha restado el valor correspondiente al calor del motor del ventilador interior. - Les valeurs nominales indiquées correspondent à des puissances brutes qui n'incluent aucune déduction pour la chaleur du moteur de ventilateur de l'unité intérieure. - I valori indicati si riferiscono alle capacità lorde e non comprendono la riduzione per l'apporto di calore generato dal motore del ventilatore dell'unità interna. - De weergegeven cijfers zijn brutocapaciteiten excl. reductiefactor voor warmte afgegeven door de binnenventilatormotor. - Указанные номинальные значения являются общими, т.е. не учитывают нагревание от двигателя внутреннего вентилятора. - Gösterilen değerler, iç ünite fan motoru sıcaklığının dikkate alınmadığı brüt kapasite değerleridir.
- shows nominal capacities. - stellt Nennleistungen dar. - υποδεικνύει ονομαστικές τιμές απόδοσης. - indica capacidades nominales. - indique les puissances nominales. - mostra le capacità nominali. - geeft nominale capaciteiten weer. - показывает номинальные значения мощности. - nominal kapasite değerlerini gösterir.
- Direct interpolation is permissible. Do not extrapolate. - Direkte Interpolation ist zulässig. Extrapolieren ist nicht zulässig. - Επιτρέπεται η απευθείας παρεμβολή. Όχι όμως η παρεκβολή. - Se permite la interpolación directa. Sin embargo, no extrapole. - Interpolation directe autorisée. Ne pas extrapoler. - È consentita l'interpolazione diretta. Non è tuttavia permessa l'estrapolazione. - Directe interpolatie is toegestaan. Extrapoler niet. - Допускается прямая интерполяция. Экстраполяция не допускается. - Doğrudan interpolasyon yapılmazına izin verilir. Ekstrapolasyon yapılmaz.
- Unit is able to operate at ambient from 0°C to 46°C without pressure trip. - Gerät kann bei Umgebungstemperaturen von 0°C bis 46°C ohne Druckabfall betrieben werden. - Η μονάδα έχει τη δυνατότητα να λειτουργεί σε θερμοκρασία περιβάλλοντος από 0°C έως 46°C χωρίς πτώση πίεσης. - La unidad puede funcionar con temperaturas ambiente de entre 0 y 46°C sin cortes por presión. - L'unité est en mesure de fonctionner par température extérieure comprise entre 0 °C et 46 °C sans déclenchement pression. - L'unità è in grado di funzionare con temperature esterne comprese tra 0° e 46° senza cali di pressione. - De unit kan werken bij omgevingstemperaturen van 0°C tot 46°C zonder drukuitschakeling. - Блок может работать при температуре окружающей среды от 0 до 46°C без отключения, вызываемого давлением. - Ünite, 0°C ila 46°C ortam sıcaklığında basınç problemi olmadan çalışabilir.

REMARK - BEMERKUNGEN - ΠΑΡΑΤΗΡΗΣΕΙΣ - OBSERVACIONES - REMARQUES - NOTE - OPMERKINGEN - ЗАМЕЧАНИЯ - DÜŞÜNCELER

- AFR: Air flow rate - Luftdurchsatz - Ταχύτητα ροής αέρα - Caudal de aire - Débit d'air - Portata d'aria - Luchtdebiet - Скорость воздушного потока - Hava akış hızı (CFM)
- EWB: Entering Wet Bulb Temp. - Eingangs-Feuchttemp. - Είσοδος σε θερμ. υγρού βολβού - Temperatura de bulbo húmedo de entrada - Température d'entrée du réservoir humide - Temp. bulbo umido in entrata - Temperatuur ingaand natte bol - Температура на входе влажного термометра. - Giriş ıslak hazne sıcaklığı (°C)
- EDB: Entering Dry Bulb Temp. - Eingangs-Trockentemp. - Είσοδος σε θερμ. λυχνίας αφύγρανσης - Temperatura de bulbo seco de entrada - Température d'entrée du réservoir sec - Temp. bulbo secco in entrata - Temperatuur ingaand droge bol - Температура на входе сухого термометра. - Giriş kuru hazne sıcaklığı (°C)
- TC: Total Cooling Capacity - Gesamte Kühlleistung - Συνολική απόδοση ψύξης - Capacidad de refrigeración total - Puissance totale de refroidissement - Capacità di raffreddamento totale - Totaal koelvermogen - Общая охлаждающая способность - Toplam soğutma kapasitesi (kW)
- SHC: Sensible Heat Capacity - Sensible Wärmekapazität - Απόδοση αισθητής θέρμανσης - Capacidad de calor sensible - Puissance calorifique sensible - Capacità termica sensibile - Voelbaar verwarmingsvermogen - Производительность по сухому теплу - Hissedilebilir ısı kapasitesi (kW)
- PI: Power Input - Leistungsaufnahme - Είσοδος ισχύος - Consumo - Puissance absorbée - Potenza assorbita - Vermogeninput - Потребляемая мощность - Güç girişi

Capacity tables

7 - 1 Capacity tables cooling

UATYQ350BY1

AFR (CFM)	EWB	EDB	Outdoor temperature																	
			19°C			25°C			30°C			35°C			40°C			46°C		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
3440	16°C	21°C	35.03	23.44	8.48	33.71	22.84	8.97	32.94	22.65	9.66	31.40	21.92	10.25	29.18	20.75	11.13	27.15	19.82	12.33
		24°C	35.17	27.32	8.49	33.84	26.70	8.98	33.07	26.58	9.67	31.54	25.88	10.26	29.41	24.44	11.15	27.53	23.17	12.35
		28°C	35.91	33.48	8.52	34.68	32.58	9.03	34.04	32.25	9.72	32.62	31.14	10.33	30.61	29.52	11.23	28.86	27.97	12.45
		30°C	36.85	36.85	8.62	35.70	35.70	9.13	34.47	34.47	9.84	33.17	33.17	10.46	31.13	31.13	11.37	29.42	29.42	12.59
	19°C	24°C	38.31	22.12	8.67	36.83	21.54	9.17	36.02	21.38	9.86	34.34	20.74	10.45	31.97	19.68	11.34	29.80	18.83	12.53
		27°C	38.41	27.23	8.67	36.95	26.62	9.17	36.12	26.51	9.87	34.46	25.83	10.46	32.08	24.62	11.35	29.93	23.75	12.54
		30°C	38.61	31.92	8.68	37.30	31.06	9.19	36.60	30.75	9.90	35.06	29.75	10.50	32.80	28.14	11.40	30.84	26.87	12.61
		33°C	39.34	39.34	8.74	37.65	37.65	9.26	37.89	37.89	9.98	36.50	36.50	10.60	33.28	33.28	11.51	31.86	31.86	12.74
	22°C	27°C	41.56	21.70	8.87	40.17	21.25	9.38	39.29	21.10	10.08	37.49	20.48	10.68	34.93	19.45	11.57	32.66	18.70	12.76
		30°C	41.87	26.99	8.88	40.27	26.39	9.39	39.36	26.29	10.09	37.59	25.64	10.69	35.02	24.47	11.58	32.75	23.65	12.77
		33°C	41.97	31.88	8.88	40.37	31.27	9.39	39.46	31.25	10.10	37.71	30.59	10.69	35.27	28.97	11.60	33.22	27.70	12.81
		36°C	42.16	35.40	8.92	40.71	34.49	9.44	40.22	34.41	10.16	38.80	33.40	10.77	36.36	31.87	11.68	34.39	30.55	12.90
4300	16°C	21°C	36.29	24.53	8.55	34.85	23.88	9.04	34.02	23.68	9.73	32.40	22.96	10.32	30.07	21.76	11.20	27.95	20.82	12.39
		24°C	36.52	30.25	8.57	35.20	29.37	9.06	34.48	28.99	9.76	32.95	27.97	10.35	30.70	26.34	11.24	28.72	25.01	12.44
		28°C	37.90	35.31	8.63	36.66	34.33	9.15	36.04	33.91	9.85	34.59	32.72	10.46	32.41	30.81	11.37	30.52	29.16	12.58
		30°C	39.29	39.29	8.76	37.99	37.99	9.28	36.84	36.84	10.00	35.22	35.22	10.61	32.66	32.66	11.52	30.84	30.84	12.74
	19°C	24°C	39.59	24.42	8.74	38.02	23.77	9.24	37.13	23.58	9.94	35.38	22.87	10.53	32.88	21.70	11.41	30.63	20.80	12.60
		27°C	39.78	30.28	8.75	38.22	29.63	9.26	37.33	29.54	9.95	35.58	28.82	10.54	33.19	27.31	11.43	31.08	25.94	12.63
		30°C	40.60	34.68	8.80	39.13	33.73	9.31	38.36	33.40	10.02	36.74	32.36	10.62	34.41	30.57	11.52	32.66	29.01	12.74
		33°C	41.47	41.47	8.89	40.14	40.14	9.42	38.74	38.74	10.15	37.25	37.25	10.77	34.97	34.97	11.69	33.09	33.09	12.91
	22°C	27°C	43.08	24.09	8.95	41.39	23.51	9.46	40.44	23.37	10.17	38.56	22.69	10.76	35.87	21.54	11.65	33.48	20.68	12.84
		30°C	43.24	30.09	8.96	41.54	29.46	9.47	40.59	29.39	10.18	38.72	28.89	10.77	36.04	27.41	11.66	33.68	26.54	12.85
		33°C	43.54	35.67	8.98	41.98	34.70	9.50	41.17	34.36	10.22	39.43	33.26	10.82	36.85	31.49	11.73	34.69	30.14	12.93
		36°C	44.35	38.50	9.05	42.79	37.73	9.57	41.71	37.05	10.30	40.17	35.87	10.93	37.36	33.52	11.86	35.05	31.60	13.09
5160	16°C	21°C	37.15	26.40	8.60	35.67	25.73	9.10	34.80	25.53	9.78	33.12	24.77	10.37	30.72	23.49	11.25	28.53	22.51	12.44
		24°C	37.81	32.08	8.64	36.37	31.12	9.14	35.60	30.73	9.83	33.99	29.65	10.42	31.67	27.96	11.31	29.72	26.40	12.52
		28°C	39.64	36.93	8.74	38.25	35.82	9.25	37.61	35.39	9.96	36.06	34.11	10.57	33.75	32.08	11.47	31.75	30.33	12.69
		30°C	40.70	40.70	8.88	39.33	39.33	9.40	37.89	37.89	10.12	36.38	36.38	10.73	34.24	34.24	11.64	31.95	31.95	12.86
	19°C	24°C	40.50	26.32	8.80	38.87	25.65	9.30	37.91	25.46	9.99	36.08	24.72	10.58	33.54	23.49	11.46	31.23	22.57	12.65
		27°C	40.77	32.98	8.81	39.19	32.20	9.32	38.38	31.80	10.02	36.66	30.68	10.62	34.18	28.93	11.51	32.02	27.53	12.71
		30°C	42.01	36.43	8.88	40.57	35.51	9.40	39.89	35.08	10.12	38.30	33.85	10.73	35.89	31.89	11.64	33.85	30.22	12.86
		33°C	42.99	42.99	9.02	41.59	41.59	9.55	40.50	40.50	10.28	38.94	38.94	10.90	36.52	36.52	11.82	34.14	34.14	13.04
	22°C	27°C	44.00	26.10	9.01	42.25	25.45	9.52	41.23	25.28	10.23	39.27	24.55	10.82	36.55	23.36	11.70	34.12	22.49	12.89
		30°C	44.25	32.84	9.03	42.49	32.17	9.54	41.47	32.11	10.24	39.52	31.38	10.84	36.83	29.94	11.72	34.56	28.51	12.92
		33°C	45.08	38.04	9.07	43.41	37.00	9.60	42.53	36.65	10.31	40.73	35.53	10.92	38.05	33.64	11.82	35.98	31.96	13.04
		36°C	45.82	39.90	9.17	43.87	38.39	9.72	43.23	38.03	10.46	41.59	36.77	11.08	38.65	34.34	12.00	36.60	32.68	13.24

NOTES - ANMERKUNGEN - ΣΗΜΕΙΩΣΕΙΣ - NOTAS - REMARQUES - NOTE - OPMERKINGEN - ПРИМЕЧАНИЯ - NOTLAR

- Ratings shown are gross capacities which do not include a deduction for indoor fan motor heat. - Die Nennwerte sind Bruttoleistungen, die keine Abzüge für die Motorwärme der Innenventilatoren enthalten. - Οι τιμές που αναφέρονται αντιπροσωπεύουν μική απόδοση, χωρίς κάποια μικρή απόκλιση που αντιστοιχεί στη θέρμανση του κινητήρα του ανεμιστήρα της εσωτερικής μονάδας. - Los valores indicados son capacidades brutas a las que no se ha restado el valor correspondiente al calor del motor del ventilador interior. - Les valeurs nominales indiquées correspondent à des puissances brutes qui n'incluent aucune déduction pour la chaleur du moteur de ventilateur de l'unité intérieure. - I valori indicati si riferiscono alle capacità lorde e non comprendono la riduzione per l'apporto di calore generato dal motore del ventilatore dell'unità interna. - De weergegeven cijfers zijn brutocapaciteiten excl. reductiefactor voor warmte afgegeven door de binnenventilatormotor. - Указанные номинальные значения являются общими, т.е. не учитывают нагревание от двигателя внутреннего вентилятора. - Gösterilen değerler, iç ünite fan motoru sıcaklığının dikkate alınmadığı brüt kapasite değerleridir.
- shows nominal capacities. - stellt Nennleistungen dar. - υποδεικνύει ονομαστικές τιμές απόδοσης. - indica capacidades nominales. - indique les puissances nominales. - mostra le capacità nominali. - geeft nominale capaciteiten weer. - показывает номинальные значения мощности. - nominal kapasite değerlerini gösterir.
- Direct interpolation is permissible. Do not extrapolate. - Direkte Interpolation ist zulässig. Extrapolieren ist nicht zulässig. - Επιτρέπεται η απευθείας παρεμβολή. Όχι όμως η παρεμβολή. - Se permite la interpolación directa. Sin embargo, no extrapole. - Interpolation directe autorisée. Ne pas extrapoler. - È consentita l'interpolazione diretta. Non è tuttavia permessa l'estrapolazione. - Directe interpolatie is toegestaan. Extrapoleren niet. - Допускается прямая интерполяция. Экстраполяция не допускается. - Doğrudan interpolasyon yapılmazına izin verilir. Ekstrapolasyon yapılmaz.
- Unit is able to operate at ambient from 0°C to 46°C without pressure trip. - Gerät kann bei Umgebungstemperaturen von 0°C bis 46°C ohne Druckabfall betrieben werden. - Η μονάδα έχει τη δυνατότητα να λειτουργεί σε θερμοκρασία περιβάλλοντος από 0°C έως 46°C χωρίς πτώση πίεσης. - La unidad puede funcionar con temperaturas ambiente de entre 0 y 46°C sin cortes por presión. - L'unité est en mesure de fonctionner par température extérieure comprise entre 0 °C et 46 °C sans déclenchement pression. - L'unità è in grado di funzionare con temperature esterne comprese tra 0° e 46° senza cali di pressione. - De unit kan werken bij omgevingstemperaturen van 0°C tot 46°C zonder drukuitschakeling. - Блок может работать при температуре окружающей среды от 0 до 46°C без отключения, вызываемого давлением. - Ünite, 0°C ila 46°C ortam sıcaklığında basınç problemi olmadan çalışabilir.

REMARK - BEMERKUNGEN - ΠΑΡΑΤΗΡΗΣΕΙΣ - OBSERVACIONES - REMARQUES - NOTE - OPMERKINGEN - ЗАМЕЧАНИЯ - DÜŞÜNCELER

- AFR: Air flow rate - Luftdurchsatz - Ταχύτητα ροής αέρα - Caudal de aire - Débit d'air - Portata d'aria - Luchtdébet - Скорость воздушного потока - Hava akış hızı (CFM)
- EWB: Entering Wet Bulb Temp. - Eingangs-Feuchttemp. - Είσοδος σε θερμ. υγρού βολβού - Temperatura de bulbo húmedo de entrada - Température d'entrée du réservoir humide - Temp. bulbo umido in entrata - Temperatuur ingaand natte bol - Температура на входе влажного термометра. - Giriş ıslak hazne sıcaklığı (°C)
- EDB: Entering Dry Bulb Temp. - Eingangs-Trockentemp. - Είσοδος σε θερμ. λυχνίας αφύγρανσης - Temperatura de bulbo seco de entrada - Température d'entrée du réservoir sec - Temp. bulbo secco in entrata - Temperatuur ingaand droge bol - Температура на входе сухого термометра. - Giriş kuru hazne sıcaklığı (°C)
- TC: Total Cooling Capacity - Gesamte Kühlleistung - Συνολική απόδοση ψύξης - Capacidad de refrigeración total - Puissance totale de refroidissement - Capacità di raffreddamento totale - Totaal koelvermogen - Общая охлаждающая способность - Toplam soğutma kapasitesi (kW)
- SHC: Sensible Heat Capacity - Sensible Wärmekapazität - Απόδοση αισθητής θέρμανσης - Capacidad de calor sensible - Puissance calorifique sensible - Capacità termica sensibile - Voelbaar verwarmingsvermogen - Производимость по сухому теплу - Hissedilebilir ısı kapasitesi (kW)
- PI: Power Input - Leistungsaufnahme - Είσοδος ισχύος - Consumo - Puissance absorbée - Potenza assorbita - Vermogeninput - Потребляемая мощность - Güç girişi

7 Capacity tables

7 - 1 Capacity tables cooling

UATYQ450BY1

AFR (CFM)	EWB	EDB	Outdoor temperature																	
			19°C			25°C			30°C			35°C			40°C			46°C		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
4520	16°C	21°C	44.03	29.82	10.49	42.37	29.06	11.10	41.41	28.82	11.95	39.46	27.89	12.68	36.67	26.40	13.77	34.12	25.22	15.25
		24°C	44.20	34.76	10.50	42.53	33.98	11.11	41.57	33.82	11.96	39.64	32.93	12.69	36.97	31.10	13.79	34.60	29.48	15.28
		28°C	45.14	42.60	10.55	43.59	41.45	11.17	42.78	41.04	12.03	41.00	39.63	12.77	38.48	37.56	13.89	36.28	35.59	15.40
		30°C	46.31	46.31	10.66	44.87	44.87	11.30	43.33	43.33	12.18	41.69	41.69	12.94	39.13	39.13	14.06	36.98	36.98	15.58
	19°C	24°C	48.15	28.14	10.72	46.29	27.41	11.34	45.27	27.20	12.20	43.16	26.39	12.93	40.18	25.04	14.03	37.46	23.96	15.50
		27°C	48.28	34.64	10.73	46.44	33.87	11.35	45.40	33.74	12.21	43.31	32.87	12.94	40.32	31.33	14.04	37.62	30.22	15.52
		30°C	48.53	40.62	10.74	46.88	39.53	11.37	46.01	39.13	12.24	44.06	37.85	12.99	41.23	35.81	14.10	38.76	34.19	15.60
		33°C	49.45	49.45	10.81	47.32	47.32	11.45	47.63	47.63	12.35	45.88	45.88	13.11	41.83	41.83	14.24	40.04	40.04	15.76
	22°C	27°C	52.24	27.61	10.98	50.49	27.04	11.61	49.38	26.84	12.48	47.12	26.05	13.21	43.90	24.75	14.31	41.05	23.79	15.79
		30°C	52.63	34.34	10.98	50.61	33.58	11.61	49.48	33.46	12.49	47.25	32.63	13.22	44.01	31.13	14.32	41.16	30.10	15.80
		33°C	52.76	40.56	10.99	50.74	39.79	11.62	49.60	39.76	12.49	47.39	38.93	13.23	44.33	36.87	14.35	41.76	35.24	15.84
		36°C	52.99	45.05	11.03	51.17	43.88	11.68	50.55	43.79	12.57	48.52	42.50	13.32	45.70	40.55	14.44	43.22	38.87	15.96
16°C	21°C	45.61	31.21	10.58	43.80	30.39	11.19	42.77	30.13	12.04	40.72	29.21	12.76	37.80	27.69	13.86	35.12	26.50	15.33	
	24°C	45.90	38.49	10.60	44.24	37.37	11.21	43.33	36.89	12.07	41.41	35.59	12.81	38.59	33.52	13.91	36.09	31.82	15.39	
	28°C	47.64	44.93	10.68	46.08	43.68	11.32	45.29	43.15	12.19	43.48	41.63	12.94	40.74	39.20	14.06	38.36	37.10	15.57	
	30°C	49.38	49.38	10.84	47.75	47.75	11.48	46.05	46.05	12.37	44.27	44.27	13.13	41.05	41.05	14.26	38.76	38.76	15.76	
5650	19°C	24°C	49.76	31.07	10.82	47.79	30.25	11.44	46.67	30.00	12.29	44.47	29.11	13.02	41.33	27.61	14.12	38.49	26.47	15.59
		27°C	50.00	38.53	10.83	48.04	37.70	11.45	46.92	37.59	12.31	44.72	36.67	13.04	41.71	34.75	14.14	39.07	33.00	15.63
		30°C	51.03	44.13	10.88	49.19	42.92	11.52	48.22	42.50	12.39	46.18	41.17	13.13	43.26	38.90	14.26	40.85	36.92	15.76
		33°C	52.12	52.12	11.00	50.46	50.46	11.66	48.70	48.70	12.56	46.82	46.82	13.32	43.95	43.95	14.46	41.59	41.59	15.97
	22°C	27°C	54.15	30.65	11.08	52.02	29.91	11.71	50.82	29.74	12.58	48.46	28.87	13.31	45.08	27.41	14.41	42.08	26.32	15.88
		30°C	54.34	38.29	11.09	52.22	37.49	11.72	51.02	37.40	12.59	48.67	36.51	13.33	45.29	34.88	14.43	42.33	33.78	15.90
		33°C	54.72	45.39	11.11	52.77	44.15	11.75	51.75	43.71	12.64	49.56	42.32	13.39	46.32	40.07	14.51	43.60	38.35	16.00
		36°C	55.74	48.99	11.19	53.78	48.01	11.84	52.42	47.14	12.75	50.49	45.64	13.52	46.96	42.65	14.67	44.05	40.21	16.20
	16°C	21°C	46.70	33.59	10.64	44.83	32.74	11.25	43.73	32.48	12.10	41.63	31.51	12.82	38.61	29.89	13.91	35.86	28.64	15.39
		24°C	47.52	40.82	10.69	45.72	39.59	11.30	44.74	39.10	12.16	42.73	37.73	12.90	39.81	35.57	13.99	37.35	33.59	15.49
		28°C	49.82	46.99	10.81	48.08	45.57	11.44	47.27	45.04	12.33	45.32	43.40	13.07	42.42	40.82	14.19	39.90	38.59	15.70
		30°C	51.16	51.16	10.98	49.43	49.43	11.63	47.62	47.62	12.52	45.72	45.72	13.28	43.03	43.03	14.40	40.15	40.15	15.91
6780	19°C	24°C	50.91	33.49	10.88	48.86	32.64	11.50	47.65	32.40	12.36	45.35	31.45	13.09	42.15	29.89	14.18	39.25	28.72	15.65
		27°C	51.25	41.96	10.90	49.26	40.97	11.53	48.24	40.47	12.40	46.07	39.04	13.14	42.96	36.82	14.24	40.24	35.02	15.72
		30°C	52.80	46.35	10.99	51.00	45.18	11.63	50.14	44.64	12.52	48.13	43.07	13.28	45.11	40.57	14.40	42.55	38.45	15.91
		33°C	54.03	54.03	11.16	52.27	52.27	11.82	50.90	50.90	12.72	48.94	48.94	13.49	45.90	45.90	14.62	42.91	42.91	16.14
	22°C	27°C	55.30	33.21	11.15	53.11	32.38	11.78	51.83	32.16	12.65	49.35	31.24	13.38	45.93	29.72	14.48	42.88	28.61	15.95
		30°C	55.62	41.78	11.17	53.40	40.93	11.80	52.12	40.86	12.67	49.67	39.93	13.41	46.29	38.09	14.51	43.44	36.28	15.99
		33°C	56.66	48.41	11.22	54.57	47.07	11.87	53.46	46.64	12.76	51.20	45.21	13.51	47.83	42.80	14.63	45.22	40.67	16.14
		36°C	57.59	50.76	11.35	55.14	48.85	12.02	54.34	48.38	12.94	52.28	46.78	13.71	48.58	43.69	14.85	46.00	41.58	16.38

NOTES - ANMERKUNGEN - ΣΗΜΕΙΩΣΕΙΣ - NOTAS - REMARQUES - NOTE - OPMERKINGEN - ПРИМЕЧАНИЯ - NOTLAR

- Ratings shown are gross capacities which do not include a deduction for indoor fan motor heat. - Die Nennwerte sind Bruttoleistungen, die keine Abzüge für die Motorwärme der Innenventilatoren enthalten. - Οι τιμές που αναφέρονται αντιπροσωπεύουν μικτή απόδοση, χωρίς κάποια μικρή απόκλιση που αντιστοιχεί στη θέρμανση του κινητήρα του ανεμιστήρα της εσωτερικής μονάδας. - Los valores indicados son capacidades brutas a las que no se ha restado el valor correspondiente al calor del motor del ventilador interior. - Les valeurs nominales indiquées correspondent à des puissances brutes qui n'incluent aucune déduction pour la chaleur du moteur de ventilateur de l'unité intérieure. - I valori indicati si riferiscono alle capacità lorde e non comprendono la riduzione per l'apporto di calore generato dal motore del ventilatore dell'unità interna. - De weergegeven cijfers zijn brutocapaciteiten excl. reductiefactor voor warmte afgegeven door de binnenventilatormotor. - Указанные номинальные значения являются общими, т.е. не учитывают нагревание от двигателя внутреннего вентилятора. - Gösterilen değerler, iç ünite fan motoru sıcaklığının dikkate alınmadığı brüt kapasite değerleridir.
- shows nominal capacities. - stellt Nennleistungen dar. - υποδεικνύει ονομαστικές τιμές απόδοσης. - indica capacidades nominales. - indique les puissances nominales. - mostra le capacità nominali. - geeft nominale capaciteiten weer. - показывает номинальные значения мощности. - nominal kapasite değerlerini gösterir.
- Direct interpolation is permissible. Do not extrapolate. - Direkte Interpolation ist zulässig. Extrapolieren ist nicht zulässig. - Επιτρέπεται η απευθείας παρεμβολή. Όχι όμως η παρεκβολή. - Se permite la interpolación directa. Sin embargo, no extrapole. - Interpolation directe autorisée. Ne pas extrapoler. - È consentita l'interpolazione diretta. Non è tuttavia permessa l'estrapolazione. - Directe interpolatie is toegestaan. Extrapoler niet. - Допускается прямая интерполяция. Экстраполяция не допускается. - Doğrudan interpolasyon yapılmazına izin verilir. Ekstrapolasyon yapılmayın.
- Unit is able to operate at ambient from 0°C to 46°C without pressure trip. - Gerät kann bei Umgebungstemperaturen von 0°C bis 46°C ohne Druckabfall betrieben werden. - Η μονάδα έχει τη δυνατότητα να λειτουργεί σε θερμοκρασία περιβάλλοντος από 0°C έως 46°C χωρίς πτώση πίεσης. - La unidad puede funcionar con temperaturas ambiente de entre 0 y 46°C sin cortes por presión. - L'unité est en mesure de fonctionner par température extérieure comprise entre 0 °C et 46 °C sans déclenchement pression. - L'unità è in grado di funzionare alle temperature esterne comprese tra 0° e 46° senza cali di pressione. - De unit kan werken bij omgevingstemperaturen van 0°C tot 46°C zonder drukuitschakeling. - Блок может работать при температуре окружающей среды от 0 до 46°C без отключения, вызываемого давлением. - Ünite, 0°C ila 46°C ortam sıcaklığında basınç problemi olmadan çalışabilir.

REMARK - BEMERKUNGEN - ΠΑΡΑΤΗΡΗΣΕΙΣ - OBSERVACIONES - REMARQUES - NOTE - OPMERKINGEN - ЗАМЕЧАНИЯ - DÜŞÜNCELER

- AFR: Air flow rate - Luftdurchsatz - Ταχύτητα ροής αέρα - Caudal de aire - Débit d'air - Portata d'aria - Luchtdebiet - Скорость воздушного потока - Hava akış hızı (CFM)
- EWB: Entering Wet Bulb Temp. - Eingangs-Feuchtemp. - Είσοδος σε θερμ. υγρού βολβού - Temperatura de bulbo húmedo de entrada - Température d'entrée du réservoir humide - Temp. bulbo umido in entrata - Temperatuur ingaand natte bol - Температура на входе влажного термометра. - Giriş ıslak hazne sıcaklığı (°C)
- EDB: Entering Dry Bulb Temp. - Eingangs-Trockentemp. - Είσοδος σε θερμ. λυχνίας αφύγρανσης - Temperatura de bulbo seco de entrada - Température d'entrée du réservoir sec - Temp. bulbo secco in entrata - Temperatuur ingaand droge bol - Температура на входе сухого термометра. - Giriş kuru hazne sıcaklığı (°C)
- TC: Total Cooling Capacity - Gesamte Kühlleistung - Συνολική απόδοση ψύξης - Capacidad de refrigeración total - Puissance totale de refroidissement - Capacità di raffreddamento totale - Totaal koelvermogen - Общая охлаждающая способность - Toplam soğutma kapasitesi (kW)
- SHC: Sensible Heat Capacity - Sensible Wärmekapazität - Απόδοση αισθητής θέρμανσης - Capacidad de calor sensible - Puissance calorifique sensible - Capacità termica sensibile - Voelbaar verwarmingsvermogen - Производительность по сухому теплу - Hissedilebilir ısı kapasitesi (kW)
- PI: Power Input - Leistungsaufnahme - Είσοδος ισχύος - Consumo - Puissance absorbée - Potenza assorbita - Vermogeninput - Потребляемая мощность - Güç girişi

Capacity tables

7 - 1 Capacity tables cooling

UATYQ550BY1

AFR (CFM)	EWB	EDB	Outdoor temperature																	
			19°C			25°C			30°C			35°C			40°C			46°C		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
5360	16°C	21°C	54.83	38.04	13.47	52.77	37.07	14.25	51.56	36.77	15.34	49.14	35.58	16.28	45.67	33.68	17.68	42.49	32.17	19.58
		24°C	55.05	44.34	13.48	52.96	43.34	14.26	51.76	43.15	15.35	49.36	42.01	16.29	46.04	39.67	17.71	43.09	37.61	19.62
		28°C	56.21	54.34	13.54	54.29	52.88	14.34	53.27	52.35	15.44	51.06	50.55	16.40	47.92	47.91	17.83	45.18	45.18	19.78
		30°C	57.67	57.67	13.68	55.88	55.88	14.50	53.95	53.95	15.63	51.92	51.92	16.61	48.73	48.73	18.05	46.05	46.05	20.00
	19°C	24°C	59.96	35.90	13.76	57.64	34.96	14.56	56.37	34.70	15.66	53.75	33.66	16.60	50.04	31.95	18.01	46.65	30.56	19.90
		27°C	60.12	44.19	13.77	57.83	43.21	14.57	56.53	43.04	15.67	53.94	41.93	16.61	50.21	39.96	18.02	46.85	38.55	19.92
		30°C	60.43	51.81	13.79	58.38	50.42	14.60	57.29	49.91	15.72	54.87	48.29	16.68	51.34	45.68	18.10	48.26	43.62	20.02
		33°C	61.57	61.57	13.88	58.92	58.92	14.70	59.31	59.31	15.85	57.14	57.14	16.83	52.10	52.10	18.29	49.86	49.86	20.24
	22°C	27°C	65.06	35.23	14.09	62.88	34.50	14.90	61.49	34.24	16.02	58.67	33.24	16.96	54.67	31.57	18.37	51.12	30.35	20.27
		30°C	65.54	43.81	14.10	63.03	42.84	14.91	61.61	42.68	16.03	58.84	41.62	16.97	54.81	39.72	18.39	51.25	38.39	20.28
		33°C	65.70	51.74	14.11	63.19	50.75	14.92	61.77	50.72	16.04	59.02	49.66	16.98	55.21	47.03	18.42	52.00	44.95	20.34
		36°C	65.99	57.46	14.16	63.72	55.98	14.99	62.96	55.86	16.13	60.42	54.22	17.10	56.91	51.73	18.54	53.83	49.59	20.49
6700	16°C	21°C	56.80	39.81	13.58	54.55	38.76	14.36	53.26	38.44	15.45	50.71	37.27	16.38	47.07	35.32	17.79	43.74	33.80	19.67
		24°C	57.15	49.10	13.60	55.10	47.67	14.40	53.96	47.06	15.50	51.57	45.40	16.44	48.05	42.76	17.85	44.95	40.60	19.76
		28°C	59.32	57.31	13.71	57.38	55.72	14.53	56.40	55.05	15.65	54.14	53.11	16.62	50.73	50.01	18.05	47.78	47.33	19.98
		30°C	61.50	61.50	13.92	59.47	59.47	14.74	57.35	57.35	15.88	55.13	55.13	16.85	51.13	51.13	18.30	48.26	48.26	20.23
	19°C	24°C	61.97	39.63	13.88	59.52	38.59	14.68	58.12	38.28	15.78	55.38	37.13	16.72	51.47	35.22	18.12	47.93	33.77	20.01
		27°C	62.27	49.15	13.90	59.82	48.09	14.70	58.43	47.95	15.80	55.69	46.78	16.74	51.95	44.33	18.15	48.65	42.10	20.06
		30°C	63.54	56.30	13.97	61.25	54.75	14.78	60.05	54.22	15.91	57.51	52.52	16.86	53.87	49.63	18.30	50.87	47.10	20.24
		33°C	64.91	64.91	14.13	62.83	62.83	14.97	60.84	60.84	16.12	58.31	58.31	17.10	54.73	54.73	18.56	51.79	51.79	20.51
	22°C	27°C	67.44	39.11	14.22	64.78	38.16	15.03	63.29	37.94	16.15	60.35	36.82	17.09	56.14	34.96	18.50	52.40	33.57	20.39
		30°C	67.67	48.84	14.24	65.03	47.82	15.05	63.54	47.70	16.17	60.61	46.57	17.11	56.41	44.49	18.52	52.71	43.09	20.41
		33°C	68.15	57.90	14.26	65.71	56.32	15.09	64.44	55.77	16.23	61.72	53.99	17.19	57.68	51.11	18.63	54.30	48.92	20.54
		36°C	69.42	62.50	14.37	66.98	61.24	15.21	65.28	60.14	16.37	62.88	58.22	17.36	58.48	54.41	18.83	54.86	51.30	20.79
8040	16°C	21°C	58.15	42.85	13.66	55.83	41.76	14.45	54.46	41.43	15.53	51.84	40.20	16.46	48.09	38.13	17.86	44.66	36.54	19.75
		24°C	59.18	52.07	13.72	56.93	50.51	14.51	55.71	49.88	15.61	53.21	48.13	16.56	49.58	45.38	17.96	46.51	42.85	19.89
		28°C	62.04	59.94	13.88	59.87	58.14	14.69	58.87	57.45	15.82	56.44	55.36	16.78	52.83	52.08	18.22	49.69	49.23	20.15
		30°C	63.71	63.71	14.10	61.56	61.56	14.93	59.30	59.30	16.07	56.94	56.94	17.04	53.59	53.59	18.49	50.00	50.00	20.42
	19°C	24°C	63.40	42.73	13.97	60.84	41.64	14.77	59.34	41.33	15.87	56.48	40.13	16.80	52.49	38.13	18.20	48.88	36.63	20.09
		27°C	63.82	53.53	14.00	61.34	52.26	14.80	60.07	51.62	15.91	57.37	49.80	16.86	53.49	46.97	18.28	50.11	44.68	20.18
		30°C	65.76	59.13	14.11	63.51	57.63	14.93	62.43	56.95	16.07	59.94	54.95	17.05	56.18	51.76	18.49	52.98	49.05	20.42
		33°C	67.29	67.29	14.33	65.09	65.09	15.17	63.39	63.39	16.33	60.95	60.95	17.31	57.16	57.16	18.77	53.44	53.44	20.72
	22°C	27°C	68.87	42.37	14.31	66.13	41.31	15.13	64.54	41.03	16.24	61.46	39.85	17.18	57.20	37.92	18.59	53.40	36.50	20.47
		30°C	69.26	53.30	14.34	66.50	52.21	15.15	64.91	52.13	16.27	61.85	50.94	17.21	57.65	48.59	18.62	54.09	46.28	20.53
		33°C	70.56	61.75	14.41	67.95	60.05	15.24	66.57	59.49	16.38	63.75	57.67	17.34	59.56	54.60	18.78	56.32	51.88	20.72
		36°C	71.72	64.76	14.57	68.66	62.31	15.43	67.67	61.72	16.61	65.10	59.68	17.59	60.50	55.73	19.07	57.28	53.04	21.03

NOTES - ANMERKUNGEN - ΣΗΜΕΙΩΣΕΙΣ - NOTAS - REMARQUES - NOTE - OPMERKINGEN - ПРИМЕЧАНИЯ - NOTLAR

- Ratings shown are gross capacities which do not include a deduction for indoor fan motor heat. - Die Nennwerte sind Bruttoleistungen, die keine Abzüge für die Motorwärme der Innenventilatoren enthalten. - Οι τιμές που αναφέρονται αντιπροσωπεύουν μικτή απόδοση, χωρίς κάποια μικρή απόκλιση που αντιστοιχεί στη θέρμανση του κινητήρα του ανεμιστήρα της εσωτερικής μονάδας. - Los valores indicados son capacidades brutas a las que no se ha restado el valor correspondiente al calor del motor del ventilador interior. - Les valeurs nominales indiquées correspondent à des puissances brutes qui n'incluent aucune déduction pour la chaleur du moteur de ventilateur de l'unité intérieure. - I valori indicati si riferiscono alle capacità lorde e non comprendono la riduzione per l'apporto di calore generato dal motore del ventilatore dell'unità interna. - De weergegeven cijfers zijn brutocapaciteiten excl. reductiefactor voor warmte afgegeven door de binnenventilatormotor. - Указанные номинальные значения являются общими, т.е. не учитывают нагревание от двигателя внутреннего вентилятора. - Gösterilen değerler, iç ünite fan motoru sıcaklığının dikkate alınmadığı brüt kapasite değerleridir.
- shows nominal capacities. - stellt Nennleistungen dar. - υποδεικνύει ονομαστικές τιμές απόδοσης. - indica capacidades nominales. - indique les puissances nominales. - mostra le capacità nominali. - geeft nominale capaciteiten weer. - показывает номинальные значения мощности. - nominal kapasite değerlerini gösterir.
- Direct interpolation is permissible. Do not extrapolate. - Direkte Interpolation ist zulässig. Extrapolieren ist nicht zulässig. - Επιτρέπεται η απευθείας παρεμβολή. Όχι όμως η παρεκβολή. - Se permite la interpolación directa. Sin embargo, no extrapole. - Interpolation directe autorisée. Ne pas extrapoler. - È consentita l'interpolazione diretta. Non è tuttavia permessa l'extrapolazione. - Directe interpolatie is toegestaan. Extrapoleer niet. - Допускается прямая интерполяция. Экстраполяция не допускается. - Doğrudan interpolasyon yapılmazına izin verilir. Ekstrapolasyon yapılmaz.
- Unit is able to operate at ambient from 0°C to 46°C without pressure trip. - Gerät kann bei Umgebungstemperaturen von 0°C bis 46°C ohne Druckabfall betrieben werden. - Η μονάδα έχει τη δυνατότητα να λειτουργεί σε θερμοκρασία περιβάλλοντος από 0°C έως 46°C χωρίς πτώση πίεσης. - La unidad puede funcionar con temperaturas ambiente de entre 0 y 46°C sin cortes por presión. - L'unité est en mesure de fonctionner par température extérieure comprise entre 0 °C et 46 °C sans déclenchement pression. - L'unità è in grado di funzionare con temperature esterne comprese tra 0° e 46° senza cali di pressione. - De unit kan werken bij omgevingstemperaturen van 0°C tot 46°C zonder drukuitschakeling. - Блок может работать при температуре окружающей среды от 0 до 46°C без отключения, вызываемого давлением. - Ünite, 0°C ila 46°C ortam sıcaklığında basınç problemi olmadan çalışabilir.

REMARK - BEMERKUNGEN - ΠΑΡΑΤΗΡΗΣΕΙΣ - OBSERVACIONES - REMARQUES - NOTE - OPMERKINGEN - ЗАМЕЧАНИЯ - DÜŞÜNCELER

- AFR: Air flow rate - Luftdurchsatz - Ταχύτητα ροής αέρα - Caudal de aire - Débit d'air - Portata d'aria - Luchtdebiet - Скорость воздушного потока - Hava akış hızı (CFM)
- EWB: Entering Wet Bulb Temp. - Eingangs-Feuchtemp. - Είσοδος σε θερμ. υγρού βολβού - Temperatura de bulbo húmedo de entrada - Température d'entrée du réservoir humide - Temp. bulbo umido in entrata - Temperatuur ingaand natte bol - Температура на входе влажного термометра. - Giriş ıslak hazne sıcaklığı (°C)
- EDB: Entering Dry Bulb Temp. - Eingangs-Trockentemp. - Είσοδος σε θερμ. λυχνίας αφύγρανσης - Temperatura de bulbo seco de entrada - Température d'entrée du réservoir sec - Temp. bulbo secco in entrata - Temperatuur ingaand droge bol - Температура на входе сухого термометра. - Giriş kuru hazne sıcaklığı (°C)
- TC: Total Cooling Capacity - Gesamte Kühlleistung - Συνολική απόδοση ψύξης - Capacidad de refrigeración total - Puissance totale de refroidissement - Capacità di raffreddamento totale - Totaal koelvermogen - Общая охлаждающая способность - Toplam soğutma kapasitesi (kW)
- SHC: Sensible Heat Capacity - Sensible Wärmekapazität - Απόδοση αισθητής θέρμανσης - Capacidad de calor sensible - Puissance calorifique sensible - Capacità termica sensibile - Voelbaar verwarmingsvermogen - Производительность по сухому теплу - Hissedilebilir ısı kapasitesi (kW)
- PI: Power Input - Leistungsaufnahme - Είσοδος ισχύος - Consumo - Puissance absorbée - Potenza assorbita - Vermogeninput - Потребляемая мощность - Güç girişi

Capacity tables

7 - 1 Capacity tables cooling

UATYQ600BY1

AFR (CFM)	EWB	EDB	Outdoor temperature																	
			19°C			25°C			30°C			35°C			40°C			46°C		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
5840	16°C	21°C	65.79	42.92	15.81	63.31	41.83	16.73	61.87	41.49	18.01	58.96	40.15	19.11	54.79	38.00	20.75	50.98	36.30	22.98
		24°C	66.05	50.03	15.82	63.54	48.91	16.74	62.11	48.69	18.02	59.22	47.41	19.12	55.24	44.77	20.78	51.70	42.44	23.03
		28°C	67.45	61.32	15.89	65.13	59.67	16.83	63.92	59.08	18.13	61.26	57.04	19.25	57.49	54.07	20.93	54.21	51.23	23.21
		30°C	69.20	69.20	16.06	67.05	67.05	17.03	64.74	64.74	18.35	62.29	62.29	19.50	58.46	58.46	21.19	55.26	55.26	23.48
	19°C	24°C	71.95	40.51	16.16	69.16	39.46	17.09	67.64	39.16	18.38	64.49	37.98	19.48	60.04	36.05	21.14	55.97	34.48	23.36
		27°C	72.14	49.87	16.17	69.39	48.76	17.10	67.83	48.57	18.39	64.72	47.31	19.50	60.24	45.09	21.15	56.21	43.50	23.38
		30°C	72.51	58.47	16.19	70.04	56.90	17.14	68.74	56.32	18.45	65.84	54.49	19.57	61.60	51.55	21.25	57.91	49.22	23.50
		33°C	73.88	73.88	16.29	70.70	70.70	17.26	71.16	71.16	18.60	68.56	68.56	19.75	62.51	62.51	21.46	59.83	59.83	23.75
	22°C	27°C	78.06	39.75	16.54	75.45	38.93	17.49	73.78	38.64	18.80	70.40	37.51	19.91	65.59	35.63	21.57	61.34	34.25	23.80
		30°C	78.64	49.44	16.55	75.63	48.34	17.50	73.93	48.16	18.81	70.60	46.97	19.92	65.77	44.82	21.58	61.50	43.32	23.81
		33°C	78.83	58.39	16.56	75.82	57.27	17.51	74.12	57.24	18.83	70.81	56.04	19.94	66.24	53.07	21.62	62.40	50.73	23.88
		36°C	79.18	64.84	16.62	76.46	63.17	17.60	75.54	63.04	18.94	72.49	61.18	20.07	68.28	58.37	21.77	64.58	55.96	24.05
7300	16°C	21°C	68.15	44.93	15.94	65.45	43.74	16.86	63.90	43.37	18.14	60.85	42.05	19.23	56.48	39.86	20.88	52.48	38.14	23.09
		24°C	68.58	55.41	15.97	66.11	53.79	16.90	64.75	53.10	18.19	61.88	51.23	19.30	57.66	48.25	20.96	53.93	45.81	23.20
		28°C	71.18	64.67	16.10	68.85	62.88	17.06	67.68	62.12	18.37	64.97	59.93	19.51	60.87	56.43	21.19	57.32	53.41	23.46
		30°C	73.79	73.79	16.34	71.35	71.35	17.30	68.81	68.81	18.64	66.14	66.14	19.78	61.34	61.34	21.48	57.91	57.91	23.75
	19°C	24°C	74.36	44.73	16.30	71.41	43.55	17.23	69.74	43.19	18.52	66.45	41.90	19.62	61.76	39.75	21.27	57.52	38.11	23.49
		27°C	74.72	55.47	16.32	71.78	54.27	17.25	70.11	54.11	18.55	66.82	52.79	19.65	62.33	50.02	21.31	58.37	47.51	23.55
		30°C	76.24	63.53	16.40	73.49	61.78	17.35	72.05	61.18	18.67	69.00	59.26	19.79	64.63	56.00	21.48	61.03	53.14	23.75
		33°C	77.88	77.88	16.58	75.39	75.39	17.57	72.76	72.76	18.92	69.96	69.96	20.08	65.67	65.67	21.79	62.14	62.14	24.07
	22°C	27°C	80.91	44.13	16.69	77.73	43.06	17.64	75.94	42.81	18.96	72.41	41.55	20.06	67.36	39.45	21.71	62.88	37.88	23.93
		30°C	81.20	55.11	16.71	78.02	53.96	17.66	76.24	53.83	18.98	72.72	52.55	20.08	67.68	50.21	21.74	63.24	48.62	23.96
		33°C	81.77	65.34	16.74	78.85	63.55	17.71	77.32	62.93	19.05	74.05	60.93	20.17	69.21	57.68	21.86	65.15	55.20	24.11
		36°C	83.29	70.53	16.87	80.36	69.10	17.85	78.33	67.86	19.21	75.44	65.69	20.38	70.16	61.40	22.10	65.82	57.89	24.41
8760	16°C	21°C	69.77	48.35	16.04	66.98	47.13	16.96	65.35	46.76	18.23	62.20	45.37	19.32	57.70	43.03	20.97	53.58	41.23	23.18
		24°C	71.01	58.76	16.10	68.31	57.00	17.03	66.85	56.28	18.33	63.84	54.31	19.43	59.48	51.21	21.09	55.81	48.35	23.34
		28°C	74.44	67.64	16.29	71.84	65.61	17.25	70.63	64.83	18.58	67.72	62.47	19.70	63.39	58.77	21.39	59.62	55.55	23.65
		30°C	76.44	76.44	16.55	73.86	73.86	17.53	71.16	71.16	18.87	68.32	68.32	20.01	64.30	64.30	21.70	59.99	59.99	23.97
	19°C	24°C	76.07	48.22	16.40	73.00	46.99	17.34	71.20	46.64	18.63	67.77	45.28	19.72	62.99	43.03	21.37	58.65	41.34	23.58
		27°C	76.57	60.41	16.43	73.60	58.97	17.37	72.07	58.25	18.68	68.84	56.20	19.79	64.19	53.00	21.46	60.13	50.42	23.69
		30°C	78.90	66.72	16.56	76.20	65.04	17.53	74.91	64.26	18.87	71.92	62.01	20.01	67.41	58.40	21.70	63.57	55.36	23.97
		33°C	80.73	80.73	16.82	78.10	78.10	17.81	76.06	76.06	19.17	73.13	73.13	20.32	68.58	68.58	22.04	64.12	64.12	24.32
	22°C	27°C	82.63	47.81	16.80	79.35	46.62	17.75	77.44	46.30	19.07	73.74	44.97	20.17	68.63	42.79	21.82	64.07	41.19	24.03
		30°C	83.11	60.14	16.83	79.79	58.92	17.78	77.88	58.82	19.10	74.21	57.49	20.20	69.17	54.83	21.86	64.90	52.22	24.10
		33°C	84.67	69.68	16.91	81.53	67.76	17.89	79.87	67.13	19.23	76.50	65.07	20.35	71.47	61.61	22.04	67.57	58.55	24.32
		36°C	86.05	73.08	17.10	82.38	70.32	18.11	81.19	69.65	19.49	78.11	67.34	20.65	72.59	62.89	22.38	68.73	59.85	24.68

NOTES - ANMERKUNGEN - ΣΗΜΕΙΩΣΕΙΣ - NOTAS - REMARQUES - NOTE - OPMERKINGEN - ПРИМЕЧАНИЯ - NOTLAR

- Ratings shown are gross capacities which do not include a deduction for indoor fan motor heat. - *Die Nennwerte sind Bruttoleistungen, die keine Abzüge für die Motorwärme der Innenventilatoren enthalten.* - Οι τιμές που αναφέρονται αντιπροσωπεύουν μικτή απόδοση, χωρίς κάποια μικρή απόκλιση που αντιστοιχεί στη θέρμανση του κινητήρα του ανεμιστήρα της εσωτερικής μονάδας. - *Los valores indicados son capacidades brutas a las que no se ha restado el valor correspondiente al calor del motor del ventilador interior.* - Les valeurs nominales indiquées correspondent à des puissances brutes qui n'incluent aucune déduction pour la chaleur du moteur de ventilateur de l'unité intérieure. - *I valori indicati si riferiscono alle capacità lorde e non comprendono la riduzione per l'apporto di calore generato dal motore del ventilatore dell'unità interna.* - De weergegeven cijfers zijn brutocapaciteiten excl. reductiefactor voor warmte afgegeven door de binnenventilatormotor. - *Указанные номинальные значения являются общими, т.е. не учитывают нагревание от двигателя внутреннего вентилятора.* - Gösterilen değeri, iç ünite fan motoru sıcaklığının dikkate alınmadığı brüt kapasite değeri'dir.
- shows nominal capacities. - *stellt Nennleistungen dar.* - υποδεικνύει ονομαστικές τιμές απόδοσης. - *indica capacidades nominales.* - indique les puissances nominales. - *mostra le capacità nominali.* - geeft nominale capaciteiten weer. - *показывает номинальные значения мощности.* - nominal kapasite değeri'ni gösterir.
- Direct interpolation is permissible. Do not extrapolate. - *Direkte Interpolation ist zulässig. Extrapolieren ist nicht zulässig.* - Επιτρέπεται η απευθείας παρεμβολή. Όχι όμως η παρεκβολή. - *Se permite la interpolación directa. Sin embargo, no extrapole.* - Interpolation directe autorisée. Ne pas extrapoler. - *È consentita l'interpolazione diretta. Non è tuttavia permessa l'estrapolazione.* - Directe interpolatie is toegestaan. Extrapoler niet. - *Допускается прямая интерполяция. Экстраполяция не допускается.* - Doğrudan interpolasyon yapılmazına izin verilir. Ekstrapolasyon yapılmaz.
- Unit is able to operate at ambient from 0°C to 52°C without pressure trip. - *Gerät kann bei Umgebungstemperaturen von 0°C bis 52°C ohne Druckabfall betrieben werden.* - Η μονάδα έχει τη δυνατότητα να λειτουργεί σε θερμοκρασία περιβάλλοντος από 0°C έως 52°C χωρίς πτώση πίεσης. - *La unidad puede funcionar con temperaturas ambiente de entre 0 y 52°C sin cortes por presión.* - L'unité est en mesure de fonctionner par température extérieure comprise entre 0 °C et 46 °C sans déclenchement pression. - *L'unità è in grado di funzionare alle temperature esterne comprese tra 0° e 52° senza cali di pressione.* - De unit kan werken bij omgevingstemperaturen van 0°C tot 52°C zonder drukuitschakeling. - *Блок может работать при температуре окружающей среды от 0 до 52°C без отключения, вызываемого давлением.* - Ünite, 0°C ila 52°C ortam sıcaklığında basınç problemi olmadan çalışabilir.

REMARK - BEMERKUNGEN - ΠΑΡΑΤΗΡΗΣΕΙΣ - OBSERVACIONES - REMARQUES - NOTE - OPMERKINGEN - ЗАМЕЧАНИЯ - DÜŞÜNCELER

- AFR: Air flow rate - *Luftdurchsatz* - Ταχύτητα ροής αέρα - *Caudal de aire* - Débit d'air - *Portata d'aria* - Luchtdebiet - *Скорость воздушного потока* - Hava akış hızı (CFM)
- EWB: Entering Wet Bulb Temp. - *Eingangs-Feuchtemp.* - Είσοδος σε θερμ. υγρού βολβού - *Temperatura de bulbo húmedo de entrada* - Température d'entrée du réservoir humide - *Temp. bulbo umido in entrata* - Temperatuur ingaand natte bol - *Температура на входе влажного термометра.* - Giriş ıslak hazne sıcaklığı (°C)
- EDB: Entering Dry Bulb Temp. - *Eingangs-Trockentemp.* - Είσοδος σε θερμ. λυχνίας αφύγρανσης - *Temperatura de bulbo seco de entrada* - Température d'entrée du réservoir sec - *Temp. bulbo secco in entrata* - Temperatuur ingaand droge bol - *Температура на входе сухого термометра.* - Giriş kuru hazne sıcaklığı (°C)
- TC: Total Cooling Capacity - *Gesamte Kühlleistung* - Συνολική απόδοση ψύξης - *Capacidad de refrigeración total* - Puissance totale de refroidissement - *Capacità di raffreddamento totale* - Totaal koelvermogen - *Общая охлаждающая способность* - Toplam soğutma kapasitesi (kW)
- SHC: Sensible Heat Capacity - *Sensible Wärmekapazität* - Απόδοση αισθητής θέρμανσης - *Capacidad de calor sensible* - Puissance calorifique sensible - *Capacità termica sensibile* - Voelbaar verwarmingsvermogen - *Производительность по сухому теплу* - Hissedilebilir ısı kapasitesi (kW)
- PI: Power Input - *Leistungsaufnahme* - Είσοδος ισχύος - *Consumo* - Puissance absorbée - *Potenza assorbita* - Vermogeninput - *Потребляемая мощность* - Güç girişi

Capacity tables

7 - 1 Capacity tables cooling

UATYQ700BY1

AFR (CFM)	EWB	EDB	Outdoor temperature																	
			19°C			25°C			30°C			35°C			40°C			46°C		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
5840	16°C	21°C	71.48	48.41	17.39	68.79	47.18	18.40	67.22	46.80	19.80	64.06	45.28	21.01	59.53	42.86	22.82	55.39	40.94	25.27
		24°C	71.76	56.43	17.40	69.04	55.16	18.41	67.48	54.91	19.82	64.35	53.47	21.03	60.02	50.49	22.86	56.18	47.87	25.33
		28°C	73.28	69.15	17.48	70.77	67.29	18.51	69.45	66.63	19.93	66.56	64.33	21.17	62.47	60.98	23.02	58.90	57.78	25.53
		30°C	75.19	75.19	17.67	72.85	72.85	18.72	70.34	70.34	20.18	67.68	67.68	21.44	63.52	63.52	23.31	60.04	60.04	25.82
	19°C	75.19	78.17	45.69	17.77	75.14	44.50	18.80	73.49	44.16	20.22	70.07	42.84	21.43	65.23	40.66	23.25	60.81	38.89	25.69
		78.17	78.38	56.24	17.78	75.39	54.99	18.81	73.70	54.77	20.23	70.32	53.36	21.44	65.45	50.85	23.26	61.07	49.06	25.71
		78.38	78.78	65.94	17.80	76.10	64.17	18.85	74.69	63.52	20.29	71.53	61.45	21.53	66.93	58.13	23.37	62.92	55.51	25.85
		78.78	80.27	80.27	17.92	76.81	76.81	18.98	77.32	77.32	20.46	74.49	74.49	21.72	67.92	67.92	23.61	65.00	65.00	26.12
	22°C	80.27	84.81	44.83	18.19	81.97	43.90	19.24	80.16	43.58	20.68	76.49	42.30	21.89	71.27	40.18	23.72	66.65	38.63	26.17
		84.81	85.44	55.76	18.20	82.17	54.52	19.25	80.32	54.31	20.69	76.71	52.97	21.91	71.46	50.54	23.74	66.82	48.86	26.18
		85.44	85.64	65.85	18.21	82.38	64.59	19.26	80.53	64.55	20.71	76.94	63.20	21.93	71.97	59.85	23.78	67.79	57.21	26.26
		85.64	86.03	73.13	18.28	83.07	71.24	19.35	82.07	71.09	20.82	78.76	69.00	22.07	74.19	65.83	23.94	70.17	63.11	26.45
16°C	21°C	74.05	50.67	17.53	71.11	49.33	18.54	69.43	48.92	19.95	66.11	47.43	21.15	61.36	44.95	22.96	57.02	43.01	25.40	
	24°C	74.51	62.49	17.56	71.83	60.66	18.58	70.35	59.89	20.01	67.23	57.77	21.22	62.64	54.42	23.05	58.60	51.66	25.51	
	28°C	77.33	72.94	17.70	74.81	70.91	18.76	73.53	70.06	20.21	70.59	67.59	21.45	66.13	63.64	23.30	62.28	60.23	25.80	
	30°C	80.17	80.17	17.96	77.52	77.52	19.03	74.76	74.76	20.50	71.87	71.87	21.76	66.65	66.65	23.62	62.92	62.92	26.12	
7300	19°C	24°C	80.79	50.44	17.92	77.59	49.11	18.95	75.77	48.71	20.37	72.20	47.25	21.58	67.10	44.83	23.39	62.49	42.97	25.84
		27°C	81.18	62.55	17.95	77.98	61.20	18.98	76.17	61.02	20.40	72.60	59.53	21.61	67.72	56.41	23.43	63.42	53.58	25.90
		30°C	82.84	71.64	18.03	79.85	69.68	19.08	78.28	69.00	20.54	74.97	66.84	21.77	70.22	63.15	23.63	66.31	59.93	26.12
		33°C	84.61	84.61	18.24	81.91	81.91	19.32	79.05	79.05	20.81	76.02	76.02	22.08	71.35	71.35	23.96	67.52	67.52	26.47
	22°C	27°C	87.91	49.77	18.36	84.45	48.56	19.40	82.51	48.28	20.85	78.67	46.86	22.06	73.18	44.49	23.88	68.31	42.73	26.32
		30°C	88.22	62.16	18.38	84.77	60.86	19.42	82.83	60.71	20.87	79.01	59.27	22.09	73.53	56.62	23.91	68.72	54.83	26.35
		33°C	88.84	73.68	18.41	85.67	71.67	19.48	84.01	70.97	20.95	80.45	68.71	22.19	75.20	65.04	24.05	70.78	62.26	26.51
		36°C	90.50	79.54	18.55	87.31	77.93	19.63	85.10	76.53	21.13	81.97	74.09	22.41	76.23	69.25	24.31	71.51	65.28	26.84
	16°C	21°C	75.81	54.53	17.64	72.78	53.15	18.65	71.00	52.73	20.05	67.58	51.16	21.25	62.69	48.53	23.06	58.21	46.50	25.50
		24°C	77.15	66.27	17.71	74.22	64.28	18.73	72.63	63.48	20.16	69.37	61.25	21.37	64.63	57.75	23.19	60.63	54.53	25.67
		28°C	80.88	76.28	17.91	78.05	73.99	18.97	76.74	73.11	20.43	73.58	70.45	21.67	68.87	66.27	23.52	64.78	62.64	26.01
		30°C	83.05	83.05	18.20	80.25	80.25	19.27	77.31	77.31	20.75	74.23	74.23	22.00	69.86	69.86	23.87	65.18	65.18	26.36
8760	19°C	24°C	82.65	54.38	18.04	79.31	52.99	19.07	77.36	52.60	20.49	73.63	51.06	21.69	68.43	48.53	23.50	63.73	46.62	25.93
		27°C	83.20	68.12	18.07	79.96	66.50	19.10	78.31	65.70	20.54	74.79	63.38	21.77	69.74	59.77	23.60	65.33	56.86	26.05
		30°C	85.72	75.24	18.21	82.79	73.35	19.27	81.39	72.47	20.75	78.14	69.93	22.00	73.24	65.87	23.87	69.07	62.43	26.36
		33°C	87.72	87.72	18.50	84.85	84.85	19.59	82.64	82.64	21.08	79.46	79.46	22.35	74.51	74.51	24.23	69.66	69.66	26.74
	22°C	27°C	89.78	53.91	18.48	86.22	52.57	19.53	84.13	52.21	20.97	80.12	50.72	22.18	74.57	48.25	23.99	69.62	46.45	26.43
		30°C	90.30	67.83	18.51	86.69	66.45	19.56	84.62	66.34	21.00	80.63	64.83	22.22	75.15	61.84	24.04	70.51	58.90	26.50
		33°C	91.99	78.59	18.60	88.59	76.42	19.67	86.78	75.71	21.14	83.11	73.39	22.38	77.65	69.49	24.24	73.42	66.03	26.74
		36°C	93.50	82.41	18.81	89.51	79.30	19.92	88.22	78.55	21.44	84.87	75.95	22.71	78.86	70.93	24.61	74.68	67.50	27.15

NOTES - ANMERKUNGEN - ΣΗΜΕΙΩΣΕΙΣ - NOTAS - REMARQUES - NOTE - OPMERKINGEN - ПРИМЕЧАНИЯ - NOTLAR

- Ratings shown are gross capacities which do not include a deduction for indoor fan motor heat. - Die Nennwerte sind Bruttoleistungen, die keine Abzüge für die Motorwärme der Innenventilatoren enthalten. - Οι τιμές που αναφέρονται αντιπροσωπεύουν μικτή απόδοση, χωρίς κάποια μικρή απόκλιση που αντιστοιχεί στη θέρμανση του κινητήρα του ανεμιστήρα της εσωτερικής μονάδας. - Los valores indicados son capacidades brutas a las que no se ha restado el valor correspondiente al calor del motor del ventilador interior. - Les valeurs nominales indiquées correspondent à des puissances brutes qui n'incluent aucune déduction pour la chaleur du moteur de ventilateur de l'unité intérieure. - I valori indicati si riferiscono alle capacità lorde e non comprendono la riduzione per l'apporto di calore generato dal motore del ventilatore dell'unità interna. - De weergegeven cijfers zijn brutocapaciteiten excl. reductiefactor voor warmte afgegeven door de binnenventilatormotor. - Указанные номинальные значения являются общими, т.е. не учитывают нагревание от двигателя внутреннего вентилятора. - Gösterilen değerler, iç ünite fan motoru sıcaklığının dikkate alınmadığı brüt kapasite değerleridir.
- shows nominal capacities. - stellt Nennleistungen dar. - υποδεικνύει ονομαστικές τιμές απόδοσης. - indica capacidades nominales. - indique les puissances nominales. - mostra le capacità nominali. - geeft nominale capaciteiten weer. - показывает номинальные значения мощности. - nominal kapasite değerlerini gösterir.
- Direct interpolation is permissible. Do not extrapolate. - Direkte Interpolation ist zulässig. Extrapolieren ist nicht zulässig. - Επιτρέπεται η απευθείας παρεμβολή. Όχι όμως η παρεμβολή. - Se permite la interpolación directa. Sin embargo, no extrapole. - Interpolation directe autorisée. Ne pas extrapoler. - È consentita l'interpolazione diretta. Non è tuttavia permessa l'extrapolazione. - Directe interpolatie is toegestaan. Extrapoleer niet. - Допускается прямая интерполяция. Экстраполяция не допускается. - Doğrudan interpolasyon yapılmazına izin verilir. Ekstrapolasyon yapılmaz.
- Unit is able to operate at ambient from 0°C to 52°C without pressure trip. - Gerät kann bei Umgebungstemperaturen von 0°C bis 52°C ohne Druckabfall betrieben werden. - Η μονάδα έχει τη δυνατότητα να λειτουργεί σε θερμοκρασία περιβάλλοντος από 0°C έως 52°C χωρίς πτώση πίεσης. - La unidad puede funcionar con temperaturas ambiente de entre 0 y 52°C sin cortes por presión. - L'unité est en mesure de fonctionner par température extérieure comprise entre 0 °C et 46 °C sans déclenchement pression. - L'unità è in grado di funzionare con temperature esterne comprese tra 0° e 52° senza cali di pressione. - De unit kan werken bij omgevingstemperaturen van 0°C tot 52°C zonder drukuitschakeling. - Блок может работать при температуре окружающей среды от 0 до 52°C без отключения, вызываемого давлением. - Ünite, 0°C ila 52°C ortam sıcaklığında basınç problemi olmadan çalışabilir.

REMARK - BEMERKUNGEN - ΠΑΡΑΤΗΡΗΣΕΙΣ - OBSERVACIONES - REMARQUES - NOTE - OPMERKINGEN - ЗАМЕЧАНИЯ - DÜŞÜNCELER

- AFR: Air flow rate - Luftdurchsatz - Ταχύτητα ροής αέρα - Caudal de aire - Débit d'air - Portata d'aria - Luchtdebiet - Скорость воздушного потока - Hava akış hızı (CFM)
- EWB: Entering Wet Bulb Temp. - Eingangs-Feuchttemp. - Είσοδος σε θερμ. υγρού βολβού - Temperatura de bulbo húmedo de entrada - Température d'entrée du réservoir humide - Temp. bulbo umido in entrata - Temperatuur ingaand natte bol - Температура на входе влажного термометра. - Giriş ıslak hazne sıcaklığı (°C)
- EDB: Entering Dry Bulb Temp. - Eingangs-Trockentemp. - Είσοδος σε θερμ. λυχνίας αφύγρανσης - Temperatura de bulbo seco de entrada - Température d'entrée du réservoir sec - Temp. bulbo secco in entrata - Temperatuur ingaand droge bol - Температура на входе сухого термометра. - Giriş kuru hazne sıcaklığı (°C)
- TC: Total Cooling Capacity - Gesamte Kühlleistung - Συνολική απόδοση ψύξης - Capacidad de refrigeración total - Puissance totale de refroidissement - Capacità di raffreddamento totale - Totaal koelvermogen - Общая охлаждающая способность - Toplam soğutma kapasitesi (kW)
- SHC: Sensible Heat Capacity - Sensible Wärmekapazität - Απόδοση αισθητής θέρμανσης - Capacidad de calor sensible - Puissance calorifique sensible - Capacità termica sensibile - Voelbaar verwarmingsvermogen - Производительность по сухому теплу - Hissedilebilir ısı kapasitesi (kW)
- PI: Power Input - Leistungsaufnahme - Είσοδος ισχύος - Consumo - Puissance absorbée - Potenza assorbita - Vermogeninput - Потребляемая мощность - Güç girişi

7 Capacity tables

7 - 2 Capacity tables heating

UATYQ250BY1

Indoor DB, °C	Outdoor WB, °C									
	-5		6		12		15		18	
	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
15	17.71	5.41	24.99	6.49	28.96	7.08	30.95	7.38	32.93	7.67
17	17.23	5.64	24.96	6.77	28.12	7.39	30.04	7.70	31.96	8.01
19	16.75	5.87	24.93	7.05	27.27	7.70	29.12	8.02	30.98	8.34
51	16.27	6.09	24.31	7.33	26.42	8.00	28.21	8.34	30.00	8.68
23	15.79	6.32	23.10	7.61	25.57	8.31	27.30	8.66	29.03	9.01
25	15.31	6.55	21.89	7.89	24.73	8.62	26.39	8.98	28.05	9.35
27	14.83	6.78	20.69	8.17	23.88	8.92	25.48	9.30	27.08	9.68

UATYQ350BY1

Indoor DB, °C	Outdoor WB, °C									
	-5		6		12		15		18	
	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
15	24.73	7.83	34.90	9.40	40.44	10.25	43.21	10.68	45.99	11.11
17	24.23	8.18	34.86	9.88	40.18	10.80	42.99	11.27	45.80	11.73
19	23.74	8.53	34.81	10.36	39.91	11.36	42.76	11.86	45.61	12.35
51	23.24	8.88	34.51	10.84	39.64	11.91	42.53	12.44	45.43	12.98
23	22.74	9.23	33.94	11.32	39.37	12.46	42.31	13.03	45.24	13.60
25	22.25	9.58	33.37	11.80	39.11	13.01	42.08	13.62	45.06	14.22
27	21.75	9.93	32.81	12.28	38.84	13.57	41.85	14.21	44.87	14.85

NOTES - Hinweise - Σημειώσεις - Notas - Remarques - Note - Aantekeningen - Примечания - Notlar

TC = Total Cooling Capacity (kW) - Gesamte Kühlleistung (kW) - Συνολική απόδοση ψύξης (kW) - Capacidad de refrigeración total (kW) - Puissance totale de refroidissement (kW) - Capacità di raffreddamento totale (kW) - Totaal koelvermogen (kW) - Общая охлаждающая способность (kW) - Toplam soğutma kapasitesi (kW)

PI = Power Input (kW) - Leistungsaufnahme (kW) - Είσοδος ισχύος (kW) - Consumo (kW) - Puissance absorbée (kW) - Potenza assorbita (kW) - Vermogeninput (kW) - Потребляемая мощность (kW) - Güç girişi (kW)

UATYQ450BY1

Indoor DB, °C	Outdoor WB, °C									
	-5		6		12		15		18	
	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
15	29.71	9.55	41.92	11.46	48.58	12.50	51.92	13.02	55.25	13.54
17	29.15	9.94	41.87	11.92	48.43	13.00	51.83	13.55	55.24	14.09
19	28.58	10.34	41.82	12.39	48.28	13.51	51.75	14.07	55.23	14.63
51	28.01	10.73	41.56	12.86	48.12	14.02	51.67	14.60	55.22	15.18
23	27.45	11.13	41.08	13.33	47.97	14.53	51.59	15.13	55.21	15.73
25	26.88	11.52	40.61	13.80	47.82	15.04	51.51	15.66	55.21	16.28
27	26.32	11.92	40.13	14.26	47.67	15.54	51.43	16.18	55.20	16.82

UATYQ550BY1

Indoor DB, °C	Outdoor WB, °C									
	-5		6		12		15		18	
	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
15	38.34	11.76	54.09	14.11	62.69	15.39	66.99	16.03	71.28	16.67
17	37.53	12.22	54.03	14.58	62.09	15.88	66.42	16.52	70.76	17.17
19	36.72	12.68	53.96	15.06	61.49	16.36	65.86	17.01	70.23	17.66
51	35.92	13.14	53.38	15.54	60.89	16.85	65.29	17.51	69.70	18.16
23	35.11	13.60	52.27	16.02	60.29	17.34	64.73	18.00	69.17	18.66
25	34.30	14.06	51.16	16.49	59.69	17.82	64.17	18.49	68.64	19.15
27	33.50	14.52	50.05	16.97	59.09	18.31	63.60	18.98	68.12	19.65

NOTES - Hinweise - Σημειώσεις - Notas - Remarques - Note - Aantekeningen - Примечания - Notlar

TC = Total Cooling Capacity (kW) - Gesamte Kühlleistung (kW) - Συνολική απόδοση ψύξης (kW) - Capacidad de refrigeración total (kW) - Puissance totale de refroidissement (kW) - Capacità di raffreddamento totale (kW) - Totaal koelvermogen (kW) - Общая охлаждающая способность (kW) - Toplam soğutma kapasitesi (kW)

PI = Power Input (kW) - Leistungsaufnahme (kW) - Είσοδος ισχύος (kW) - Consumo (kW) - Puissance absorbée (kW) - Potenza assorbita (kW) - Vermogeninput (kW) - Потребляемая мощность (kW) - Güç girişi (kW)

7 Capacity tables

7 - 2 Capacity tables heating

UATYQ600BY1

Indoor DB, °C	Outdoor WB, °C									
	-5		6		12		15		18	
	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
15	43.85	14.19	61.88	17.03	71.71	18.58	76.63	19.36	81.55	20.13
17	42.61	14.83	61.81	17.91	69.37	19.58	74.10	20.42	78.82	21.26
19	41.38	15.47	61.73	18.78	67.04	20.59	71.56	21.49	76.09	22.39
51	40.14	16.10	60.05	19.65	64.70	21.59	69.03	22.55	73.36	23.52
23	38.90	16.73	56.76	20.52	62.36	22.59	66.50	23.62	70.64	24.65
25	37.67	17.37	53.47	21.39	60.02	23.59	63.96	24.69	67.91	25.79
27	36.43	18.00	50.18	22.27	57.68	24.59	61.43	25.75	65.18	26.92

UATYQ700BY1

Indoor DB, °C	Outdoor WB, °C									
	-5		6		12		15		18	
	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
15	49.48	13.42	69.82	16.11	80.91	17.57	86.46	18.30	92.00	19.03
17	48.43	14.02	69.73	16.93	80.08	18.52	85.67	19.31	91.26	20.10
19	47.38	14.63	69.65	17.76	79.26	19.46	84.88	20.32	90.51	21.17
51	46.32	15.22	68.86	18.58	78.43	20.41	84.09	21.33	89.76	22.24
23	45.27	15.82	67.37	19.40	77.60	21.36	83.31	22.33	89.01	23.31
25	44.22	16.42	65.87	20.23	76.77	22.31	82.52	23.34	88.26	24.38
27	43.17	17.02	64.38	21.05	75.95	23.25	81.73	24.35	87.52	25.45


NOTES - Hinweise - Σημειώσεις - Notas - Remarques - Note - Aantekeningen - Примечания - Notlar

TC = Total Cooling Capacity (kW) - Gesamte Kühlleistung (kW) - Συνολική απόδοση ψύξης (kW) - Capacidad de refrigeración total (kW) - Puissance totale de refroidissement (kW) - Capacità di raffreddamento totale (kW) - Totaal koelvermogen (kW) - Общая охлаждающая способность (kW) - Toplam soğutma kapasitesi (kW)

PI = Power Input (kW) - Leistungsaufnahme (kW) - Είσοδος ισχύος (kW) - Consumo (kW) - Puissance absorbée (kW) - Potenza assorbita (kW) - Vermogeninput (kW) - Потребляемая мощность (kW) - Güç girişi (kW)

8 Dimensional drawing & centre of gravity


UATYQ250BY1

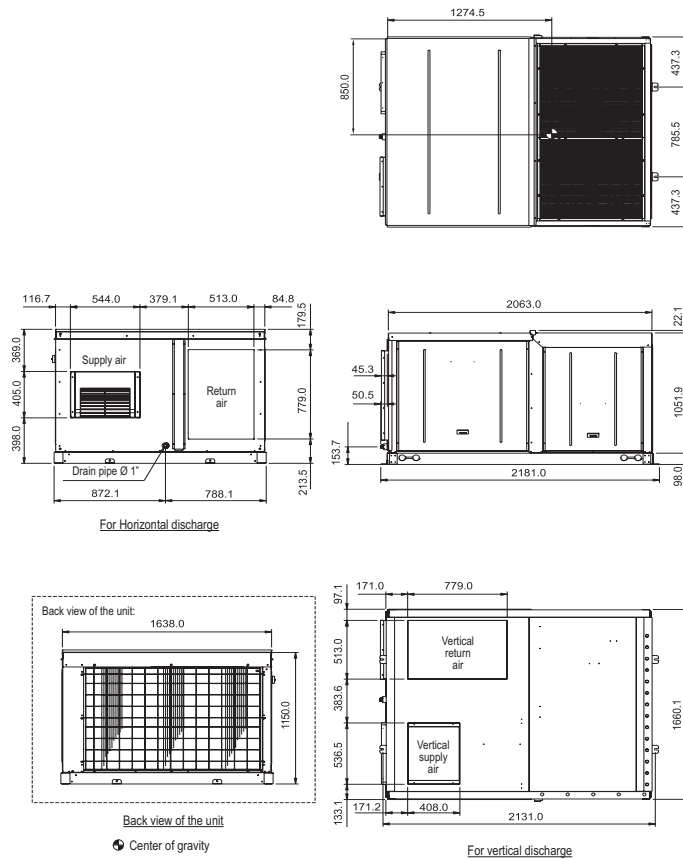

NOTES

- All dimensions are in mm

UATYQ350BY1

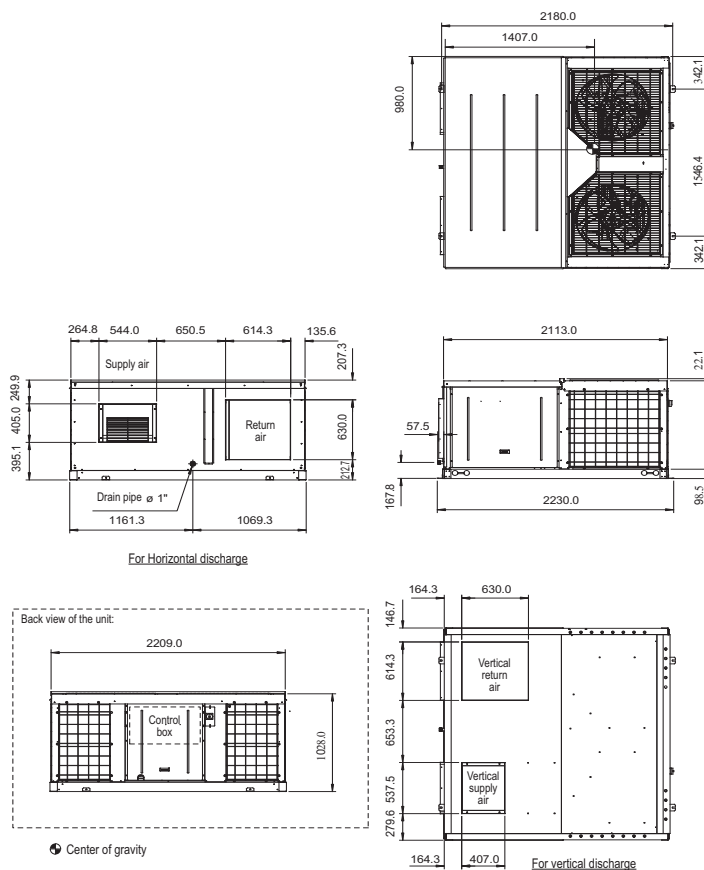


NOTES

- All dimensions are in mm

8 Dimensional drawing & centre of gravity


UATYQ450BY1

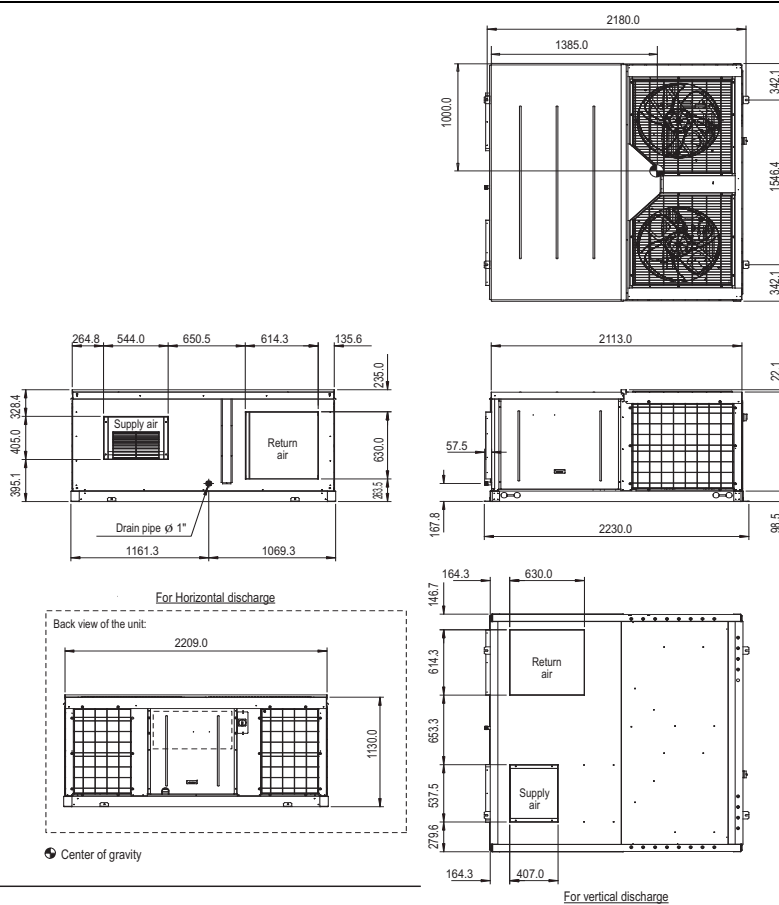

NOTES

- All dimensions are in mm

UATYQ550,600,700BY1

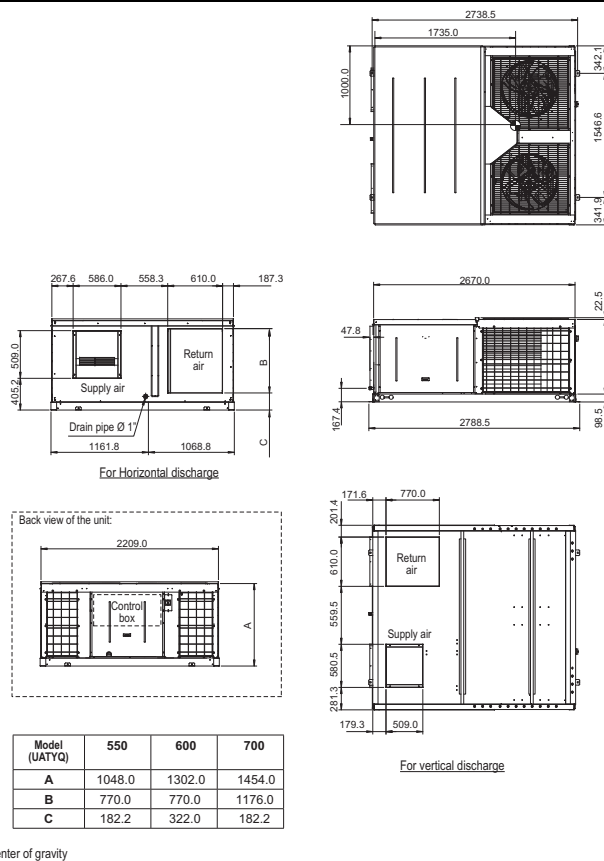


NOTES

- All dimensions are in mm

9 Piping diagram

UATYQ-BY1

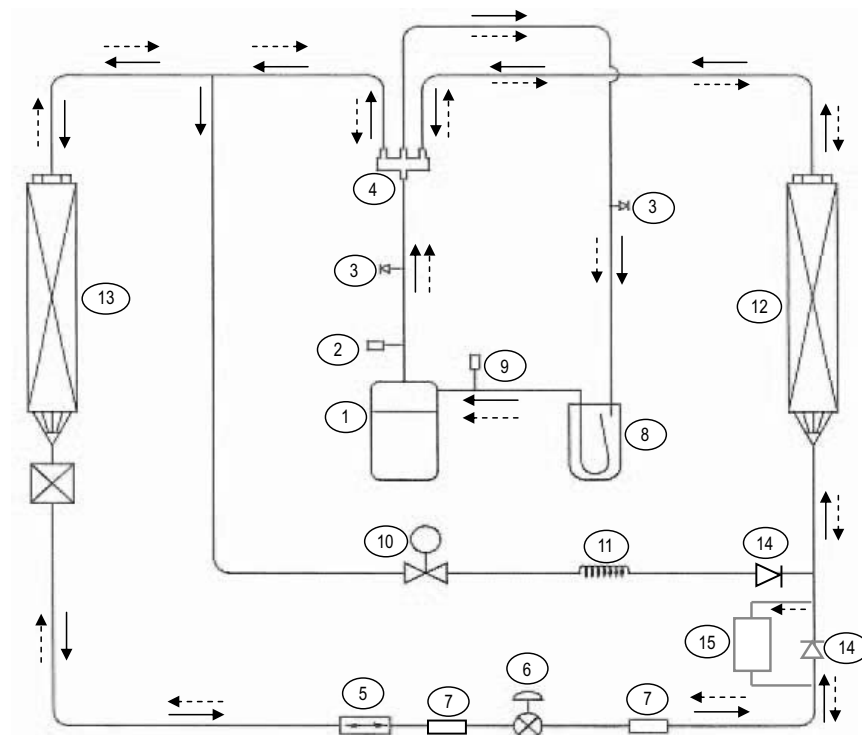

Item	Part's model / part no / size
1	Compressor
2	Pressure Switch 600PSI N/C
3	Access valve
4	4WV
5	Filter Drier
6	EXV
7	Strainer
8	Accumulator
9	Pressure Switch 18PSI N/C
10	Solenoid Valve
11	Bypass Capillary Tube
12	ID Coil
13	OD Coil
14	Check Valve
15	Compensator



→	Cooling operation
←	Heating Operation

NOTES

- (a) UATYQ350,450,550BY1 consists of 2 circuits in the systems.
 (b) Item 15 is applicable for UATYQ350BY1 only.

10 Wiring diagram

UATYQ250BY1

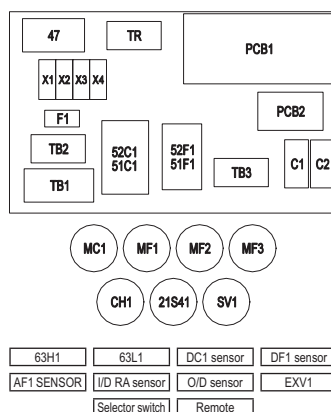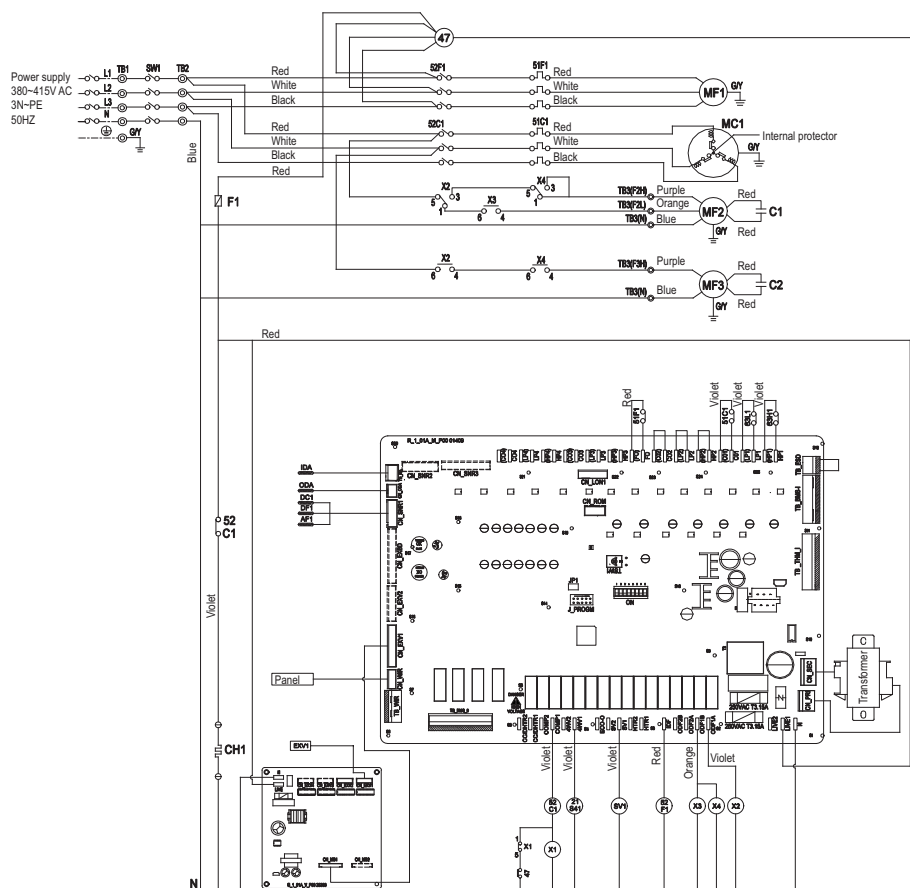

Symbol	Name
MC1/MC2	Compressor motor
MF1	Fan Motor (Indoor)
MF2,3	Fan Motor (Outdoor)
52C1/51C2	Contactors (Compressor)
TB 1,2,3,4	Terminal Block
F1	Fuse
51F1	Over current Relay (Fan I/D)
CH1/CH2	Crankcase Heater
47	Phase Protector
63H1/63H2	High Pressure Switch
63L1/63L2	Low Pressure Switch
C1, C2	Capacitor (O/D Fan Motor)
SV1/SV2	Solenoid Coil
21S41/21S42	4-Way Valve
X1,X2, X3, X4	Auxilliary Relays
SW1	Selector Switch
TR	Transformer 230V~24V
TB_RA	I/D Return Air Sensor
CN_ODA	O/D Air Sensor
CN_SNR1	Sensor DC1, DF1 & AF1
CN_SNR2	Sensor DC2, DF2 & AF2
CN_EXV1/CN_EXV2	Expansion Valve
CN_WIR	Panel Remote Control

0802 4 106498B

NOTES



1. The dotted lines show field wiring.
2. The figure in the parenthesis show field supply parts.
3. Color of earth wire is yellow and green twisting.
4. Specification subject to change without notice.

CAUTION

1. To protect Indoor Fan motor from abnormal current, Over Current Relay <51F>, is installed. Therefore, do not change factory set value of the Over Current Relay.

10 Wiring diagram

UATYQ350-550BY1

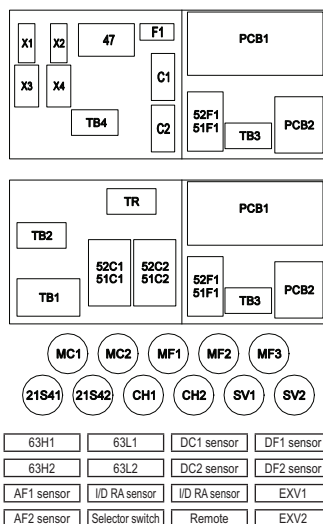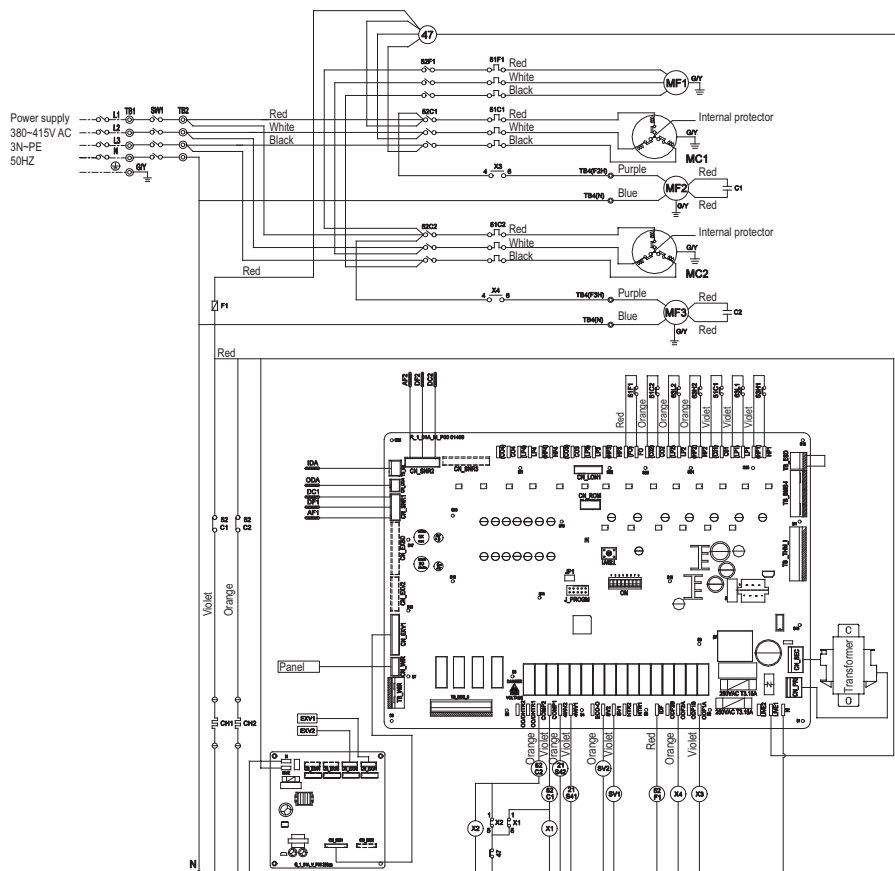

Symbol	Name
MC1/MC2	Compressor motor
MF1	Fan Motor (Indoor)
MF2,3	Fan Motor (Outdoor)
52C1/51C2	Contactors (Compressor)
52F1	Contactors (Fan I/D)
51C1/51C2	Over Current Relay (compressor)
TB 1,2,3,4	Terminal Block
F1	Fuse
51F1	Over current Relay (Fan I/D)
CH1/CH2	Crankcase Heater
47	Phase Protector
63H1/63H2	High Pressure Switch
63L1/63L2	Low Pressure Switch
C1, C2	Capacitor (O/D Fan Motor)
SV1/SV2	Solenoid Coil
21S41/21S42	4-Way Valve
X1,X2, X3, X4	Auxiliary Relays
SW1	Selector Switch
TR	Transformer 230V~24V
TB_RA	I/D Return Air Sensor
CN_ODA	O/D Air Sensor
CN_SNR1	Sensor DC1, DF1 & AF1
CN_SNR2	Sensor DC2, DF2 & AF2
CN_EXV1/CN_EXV2	Expansion Valve
CN_WIR	Panel Remote Control

0802 4 106505B

NOTES


- The dotted lines show field wiring.
- The figure in the parenthesis show field supply parts.
- Color of earth wire is yellow and green twisting.
- Specification subject to change without notice.

CAUTION



- To protect Indoor Fan motor from abnormal current, Over Current Relay <51F>, is installed. Therefore, do not change factory set value of the Over Current Relay.

10 Wiring diagram

UATYQ600-700BY1

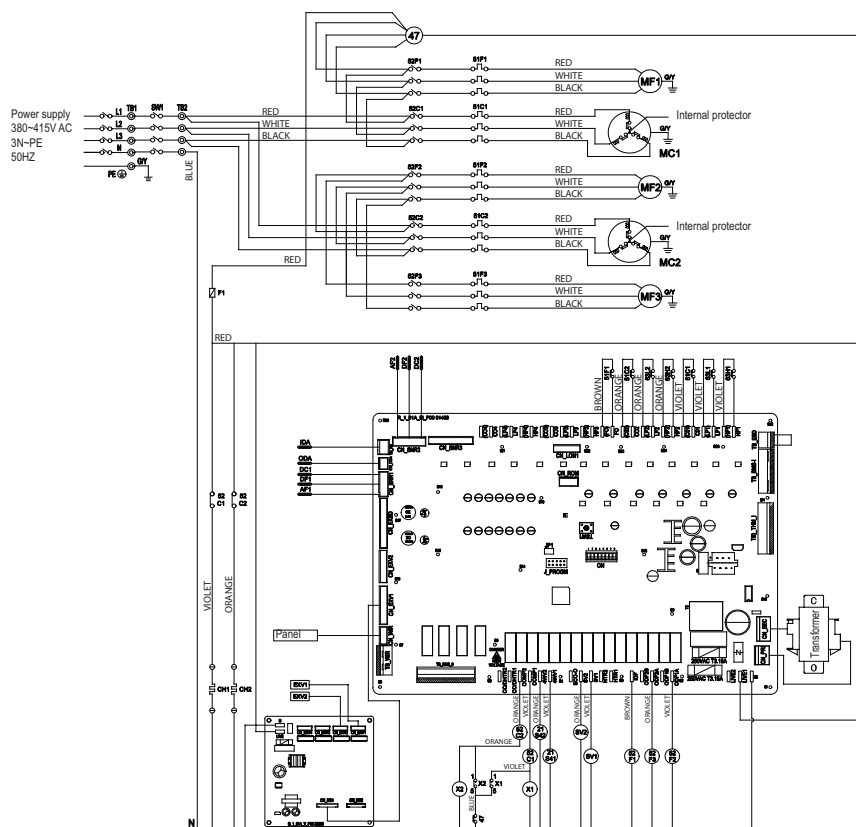

Arrangement

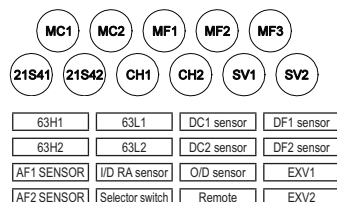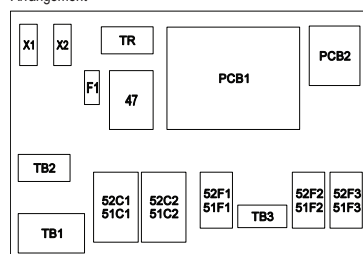

Colors

RED : Red
WHITE : White
BLACK : Black
VIOLET : Violet
ORANGE : Orange
BLUE : Blue

Symbol	Name
MC1/MC2	Compressor motor
MF1	Fan Motor (Indoor)
MF2,3	Fan Motor (Outdoor)
52C1/51C2	Contactora (Compressor)
52F1	Contactora (Fan I/D)
52F2/51F3	Contactora (Fan O/D)
51C1/51C2	Over Current Relay (Compressor)
TB 1,2,3,4	Terminal Block
F1	Fuse
51F1	Over current Relay (Fan I/D)
CH1/CH2	Crankcase Heater
47	Phase Protector
63H1/63H2	High Pressure Switch
63L1/63L2	Low Pressure Switch
SV1/SV2	Solenoid Coil
21S41/21S42	4-Way Valve
X1,X2	Auxilliary Relays
SW1	Selector switch
TR	Transformer 230V~24V
TB_RA	I/D Return Air Sensor
CN_ODA	O/D Air Sensor
CN_SNR1	Sensor DC1, DF1 & AF1
CN_SNR2	Sensor DC2, DF2 & AF2
CN_EXV1/CN_EXV2	Expansion Valve
CN_WIR	Panel Remote Control

0802 4 107686

NOTES


- The dotted lines show field wiring.
- The figure in the parenthesis show field supply parts.
- Color of earth wire is yellow and green twisting.
- Specification subject to change without notice.

CAUTION

- To protect Indoor Fan motor from abnormal current, Over Current Relay <51F>, is installed. Therefore, do not change factory set value of the Over Current Relay.

11 Sound data


11 - 1 Sound pressure spectrum

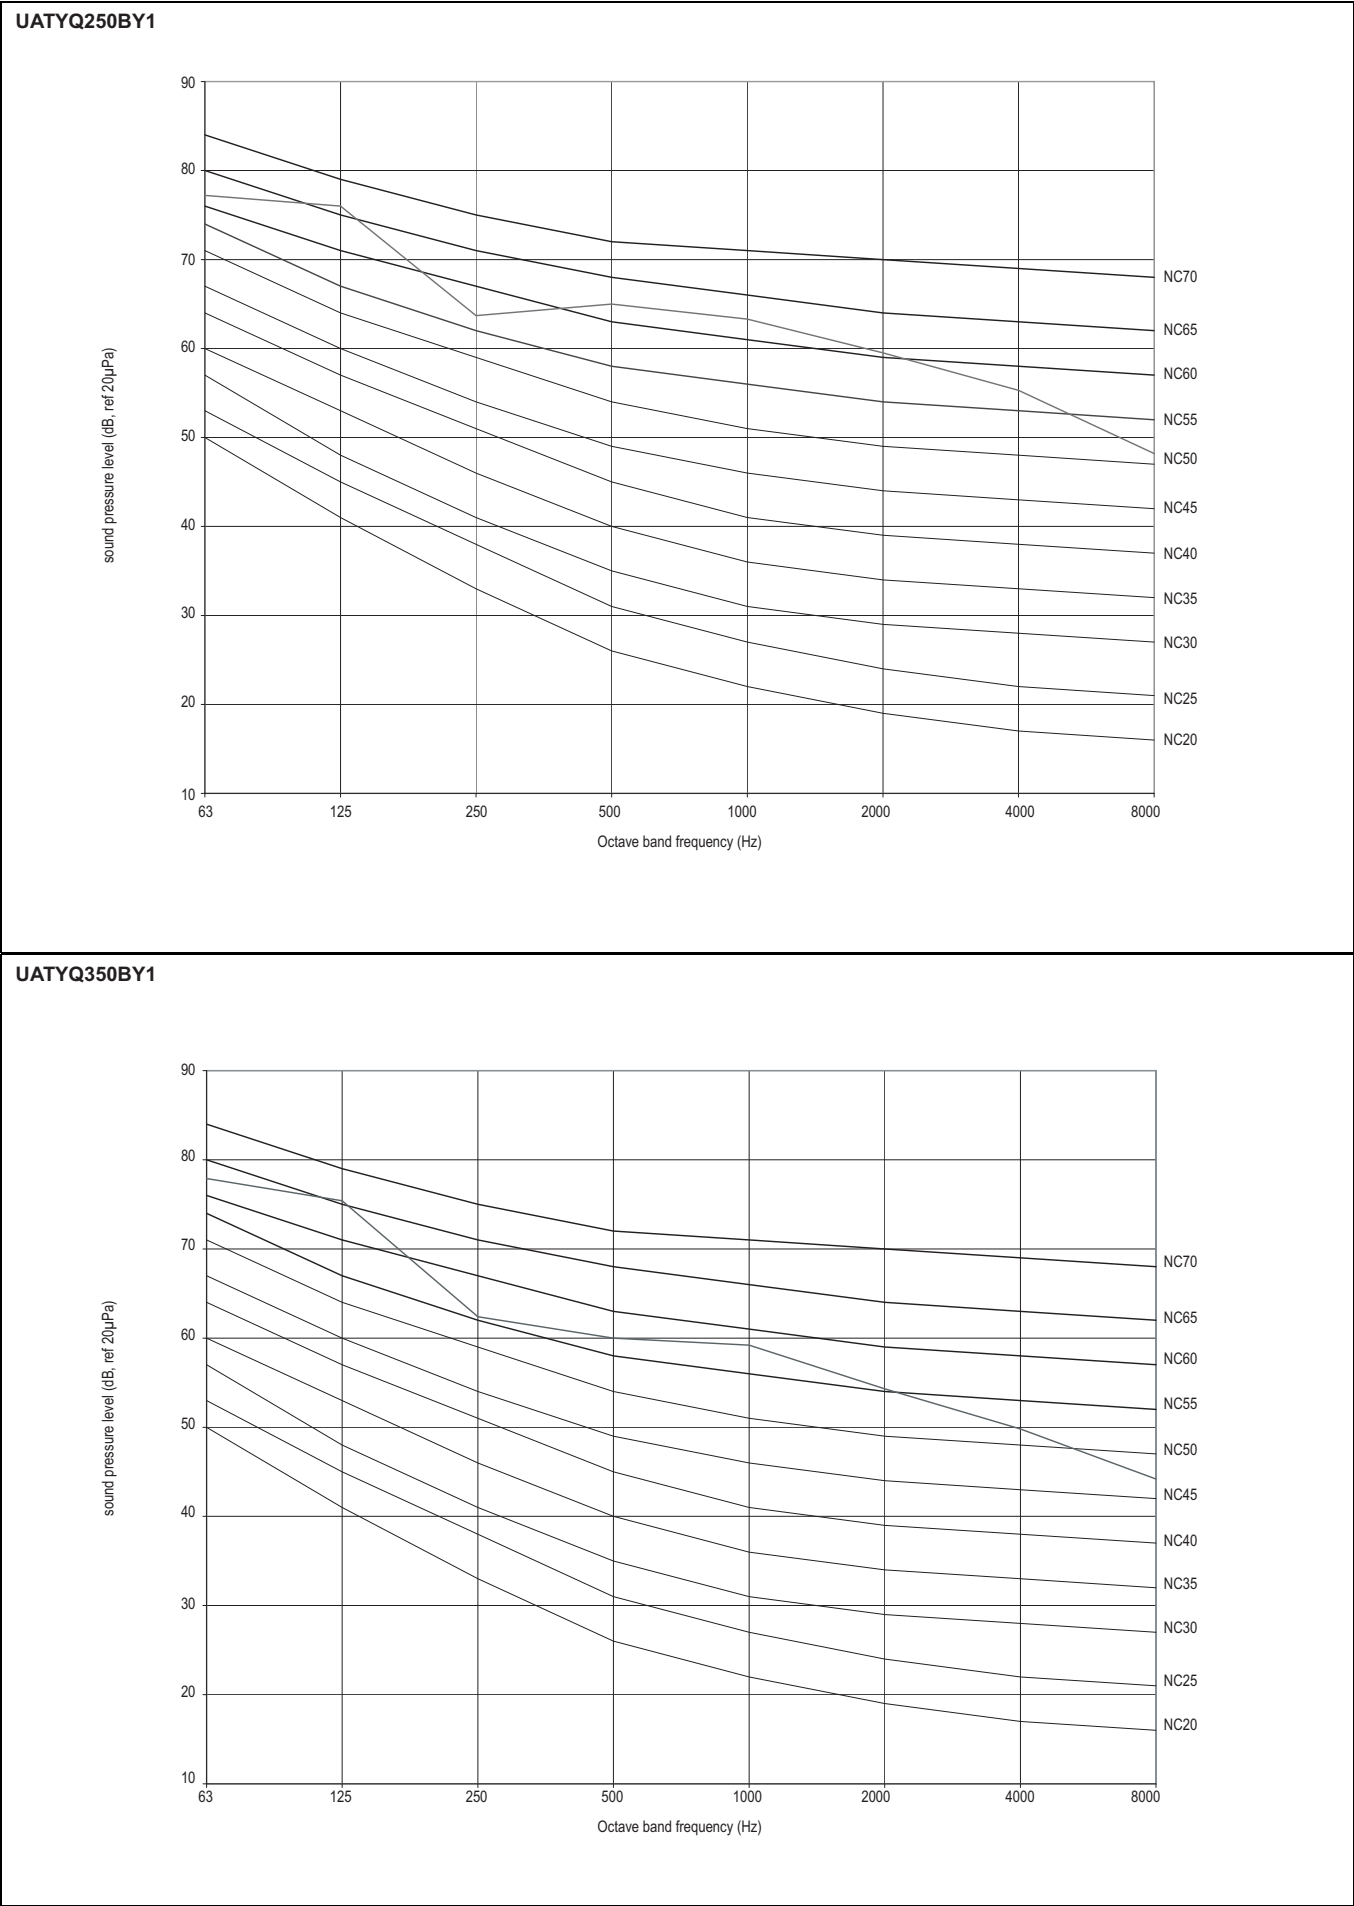


11 Sound data

11 - 1 Sound pressure spectrum

UATYQ450BY1

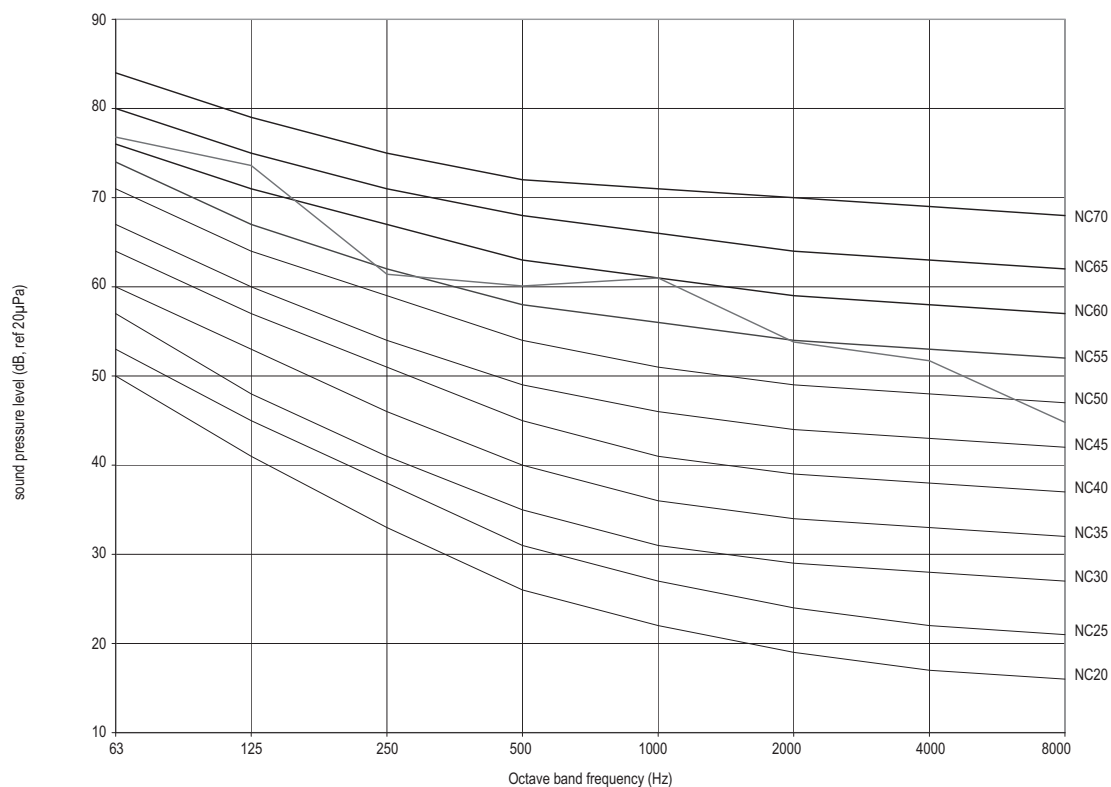


UATYQ550BY1

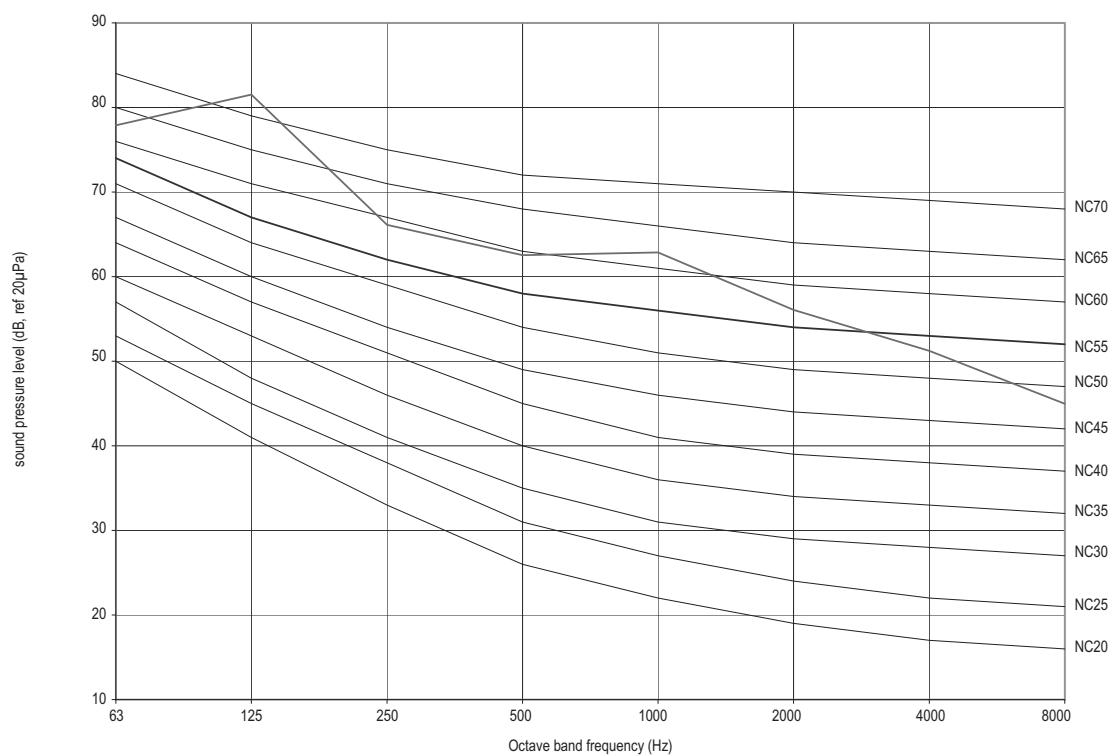

11 Sound data

11 - 1 Sound pressure spectrum

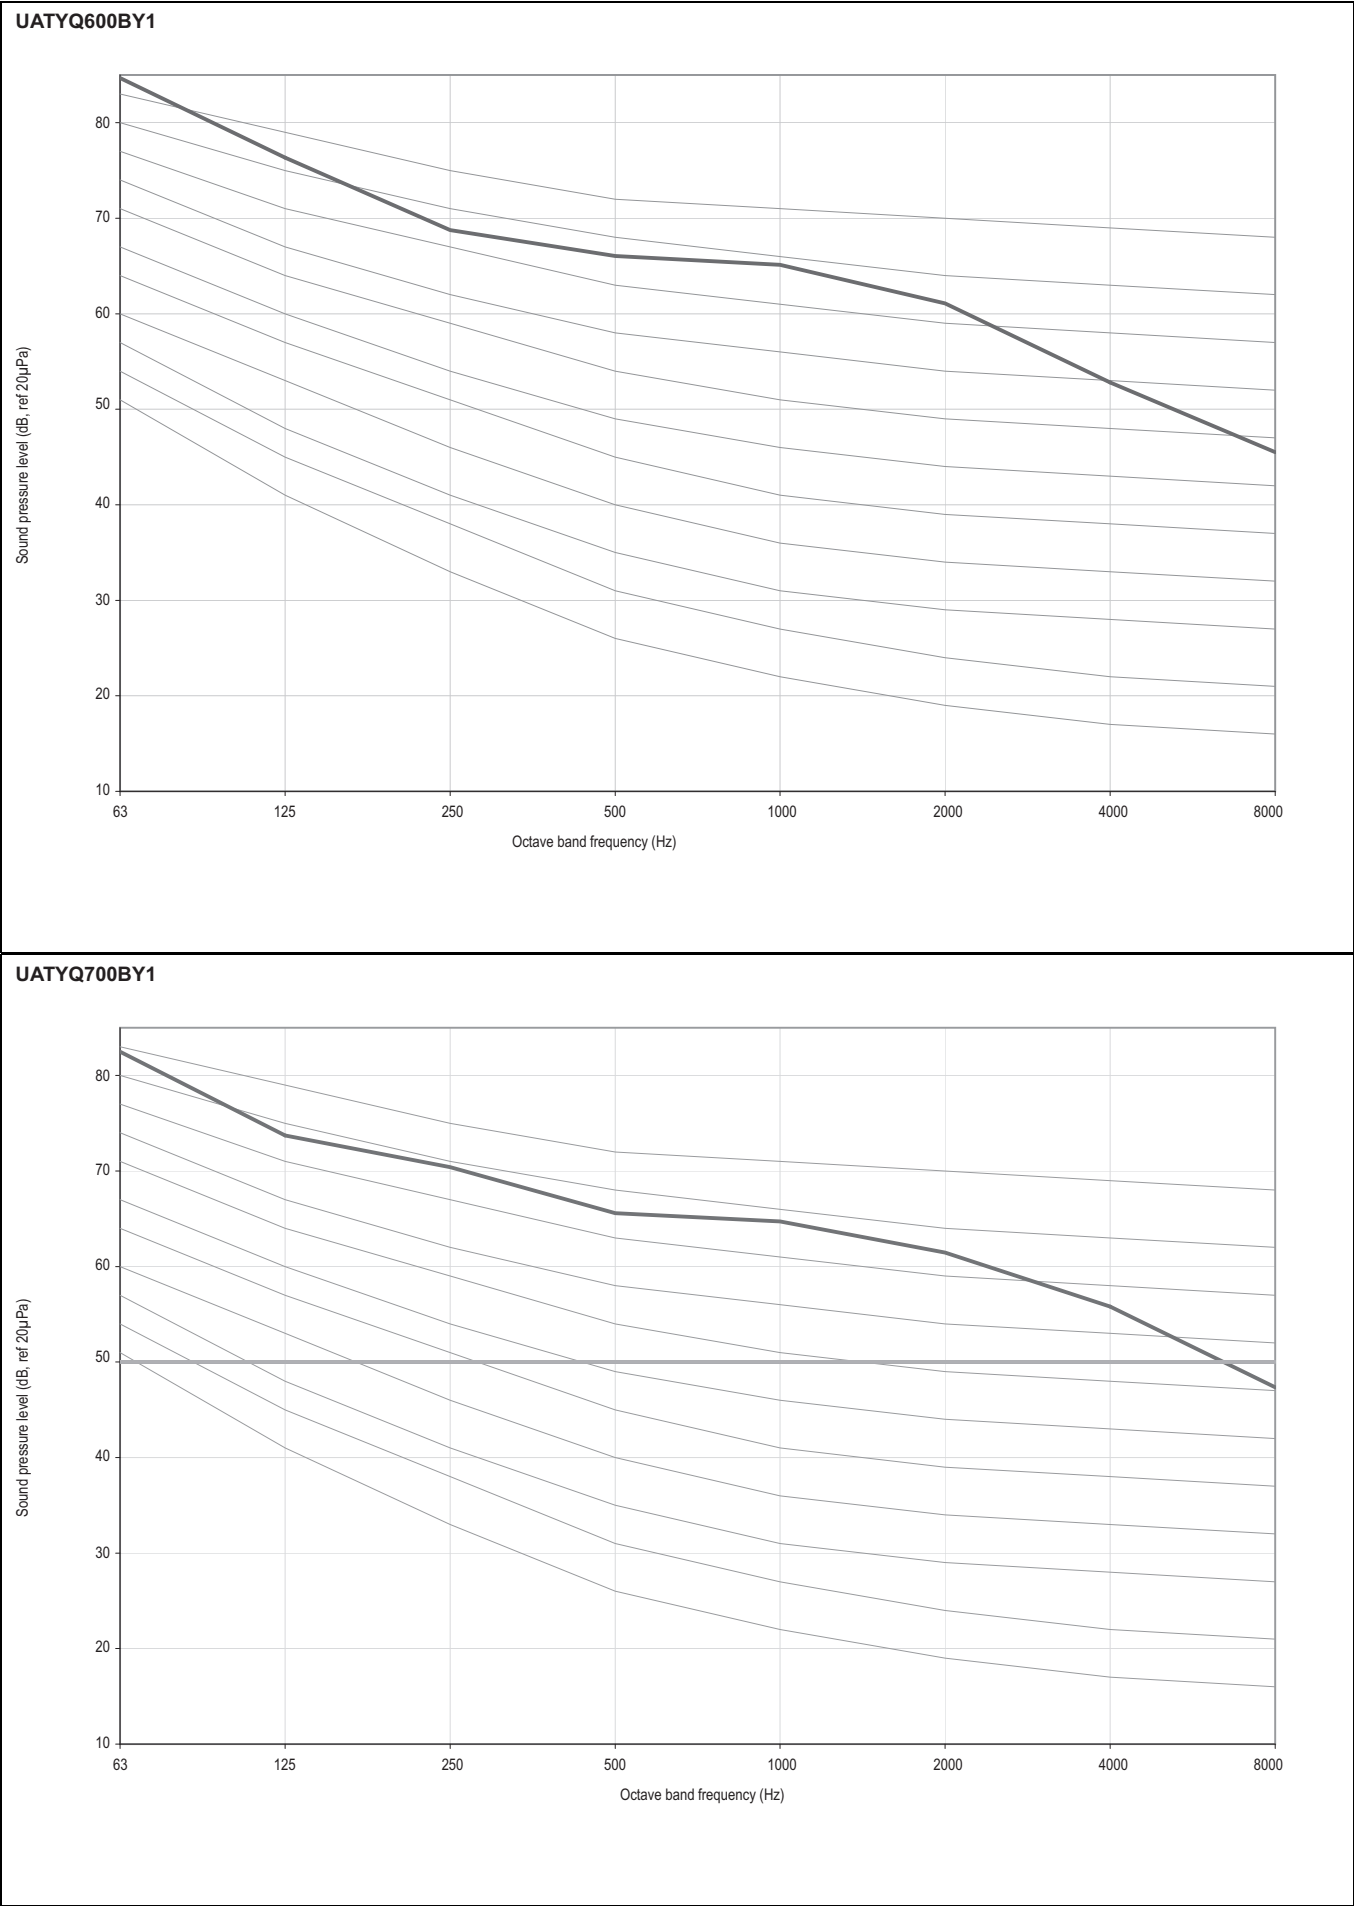

11 Sound data





11 - 2 Sound level data

UATYQ250-700BY1

Model	1/1 Octave Sound Pressure Level (dB, ref 20μPa)								Overall dB(A)	Noise Criteria (NC)
	63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz		
UATYQ250BY1	77	76	64	65	63	60	55	48	68	66
UATYQ350BY1	78	75	62	60	59	54	50	44	64	65
UATYQ450BY1	77	74	61	60	61	54	52	54	65	63
UATYQ550BY1	78	82	66	63	63	56	51	45	68	73
UATYQ600BY1	85	76	69	66	65	61	53	46	70	66
UATYQ700BY1	83	74	70	66	65	62	56	47	70	68


Model	1/1 Octave Sound Power Level (dB, ref 1pW)								Overall dB(A)
	63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz	
UATYQ250BY1	91	91	79	78	78	72	68	61	82
UATYQ350BY1	96	91	79	78	80	72	70	64	83
UATYQ450BY1	93	90	79	78	80	73	71	64	83
UATYQ550BY1	95	96	83	82	84	78	73	66	87
UATYQ600BY1	101	94	87	85	87	81	76	69	90
UATYQ700BY1	99	91	88	85	86	83	77	69	90

12 Fan characteristics

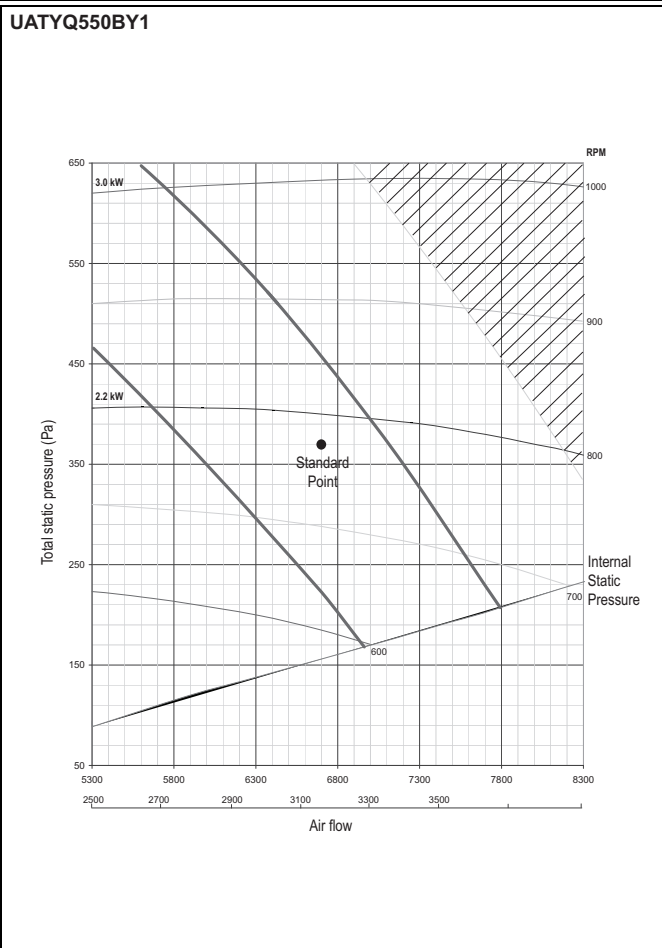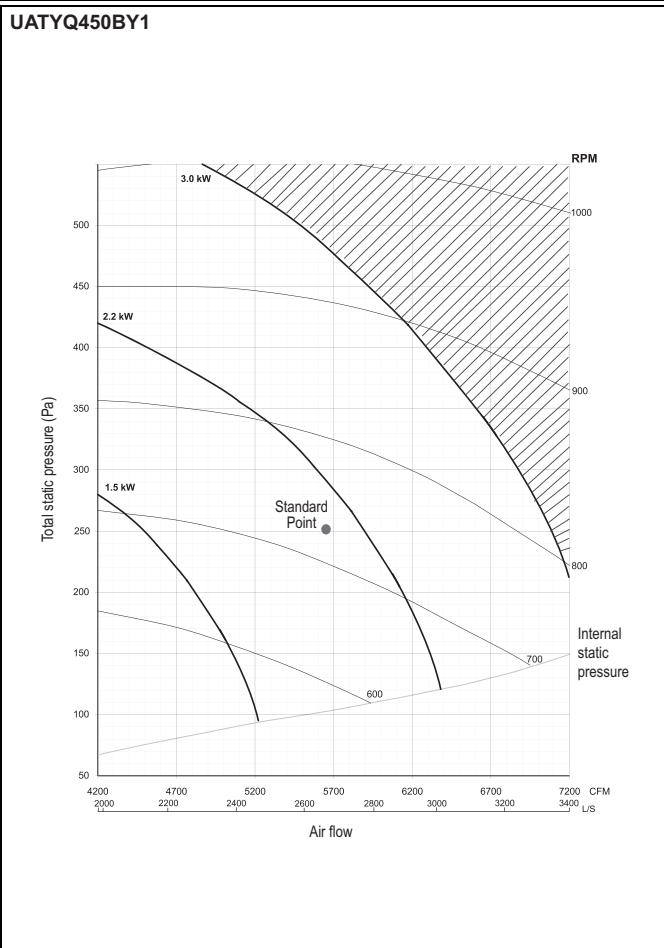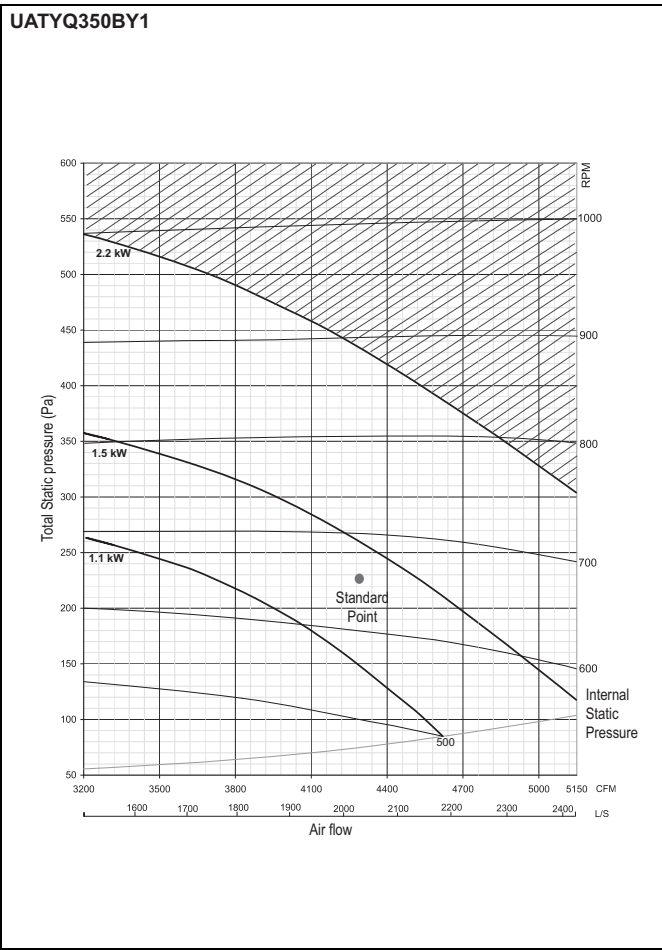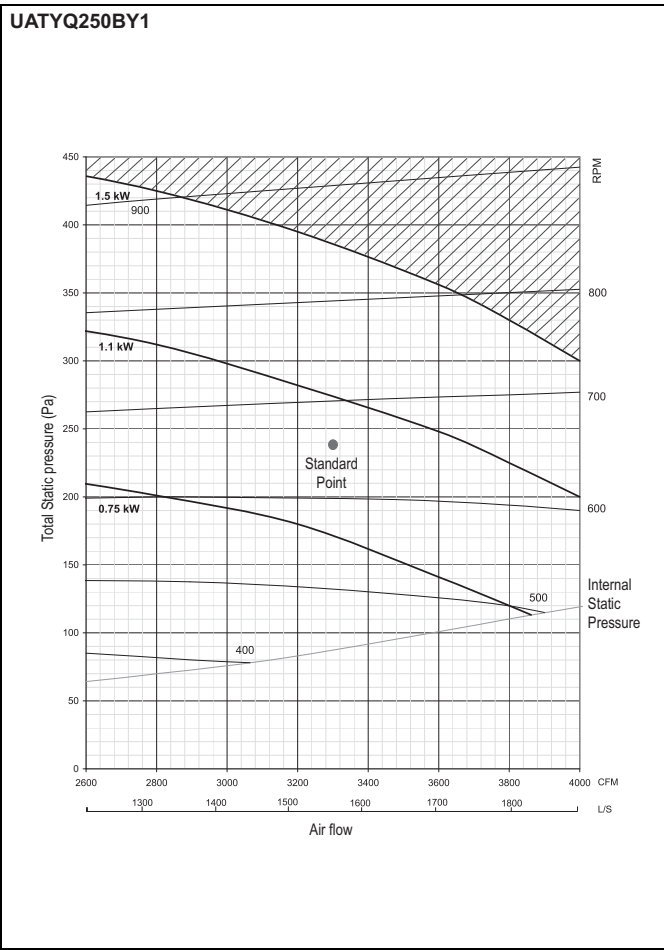


12 Fan characteristics

UATYQ600BY1

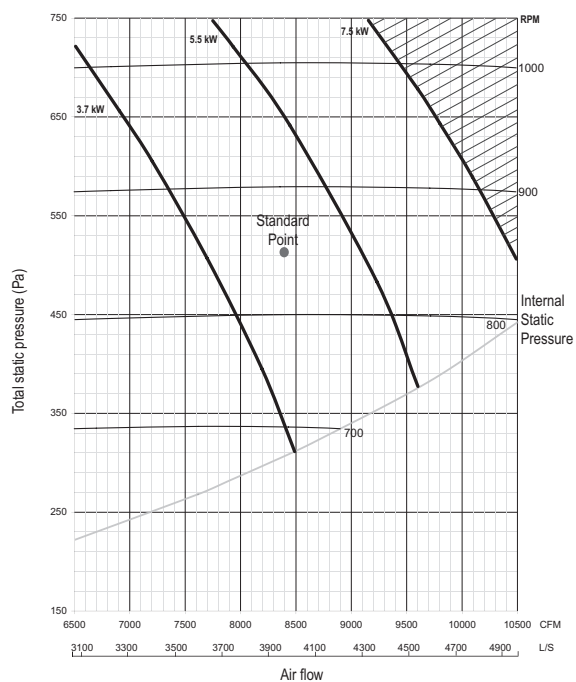

UATYQ700BY1

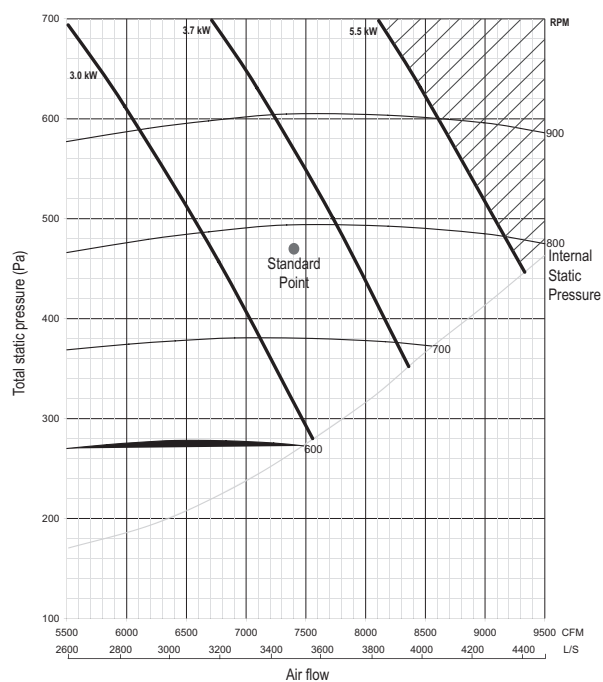



13 Installation

13 - 1 Roofcurb drawings

UATYQ250-700BY1


Unit Support (For down throw unit only)

1. The figure shows the use of the roof curb for mounting these units.
2. The curb should be sealed and fixed to the roof by weather stripping. A suggested means of sealing the unit and roof curb as shown in the right.
3. Recommended roof curb dimension is shown below.

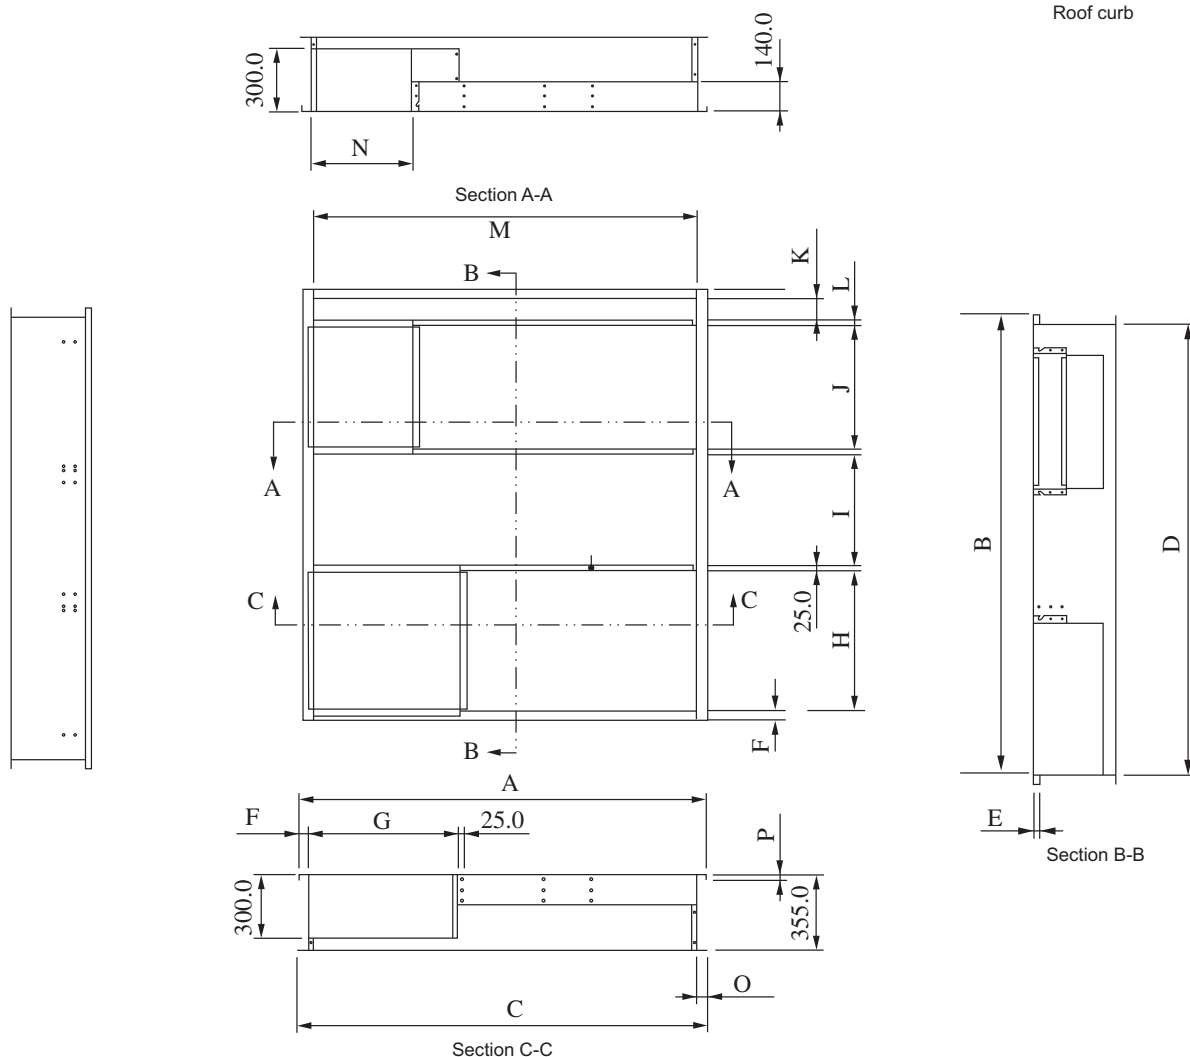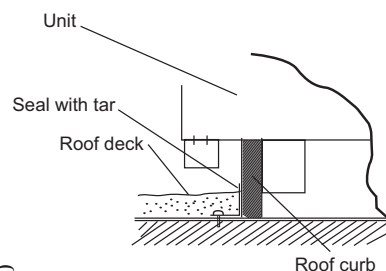

Model (UATYQ)	250	350/450	550/600/700
A	1821.0	1890.0	2448.0
B	1505.5	2081.0	2081.0
C	1881.0	1908.0	2466.0
D	1468.5	1998.0	1998.0
E	15.0	25.0	25.0
F	20.0	43.0	46.0
G	838.2	698.7	827.0
H	538.1	676.0	676.0
I	272.4	538.9	444.6
J	605.1	599.8	645.8
K	0.0	104.6	104.6
L	0.0	25.0	25.0
M	1781.0	1804.0	2362.0
N	479.7	475.7	589.0
O	50.0	52.0	52.0
P	15.0	25.0	25.0

Note: All dimensions are in mm

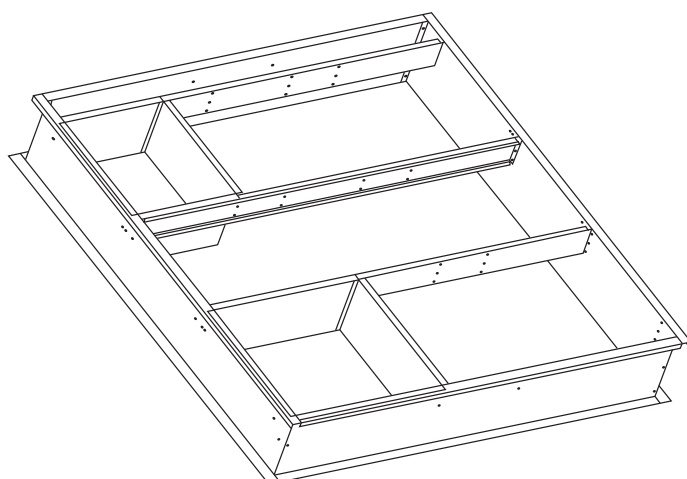

13 Installation

13 - 2 Pulley

UATYQ250BY1

The following are the design requirements for UATYQ250BY1 unit:

Model : UATYQ250BY1 unit

Supply air Quantity = 1600 l/s

External Static Pressure = 175 Pa

Step 1	From the blower curve (at 1600 l/s) Standard operating system; Internal Static Pressure = 90 Pa
Step 2:	Therefore at 1600 l/s and 175 Pa external static pressure Total Static Pressure = 175 + 90 Pa = 265 Pa
Step 3:	From the blower curve, the design requirement calls for RPM about 690 RPM. From the table: Motor pulley = 71 mm Blower pulley = 160 mm Motor RPM = 1480 RPM In order to obtain 680 RPM, we calculate the new blower pulley as: (while maintaining the motor pulley) Db = 71 x (1480/690) = 152.3 mm Let us take close approximation of 150 mm diameter pulley size Recheck, with Db = 150 mm Blower pulley = 1480 x (71/150) = 700 RPM We thus need to change the blower pulley from 160 mm to 150 mm in order to obtain the higher operating static pressure
Step 4:	When the pulley is changed, the V-belt length must be rechecked. V-belt length, L = 2C + 1.57 (Db + Dm) + (Db - Dm) ² / 4C = (2x545) + 1.57 (150 + 71) + (150 - 71) ² / 4x545 = 1439.8 We thus can use a belt with length of 1440 mm Where, C = 545 mm distance between the centres of the two pulleys
Step 5:	From the blower curve, we can also notice that the motor power input has maintained within the current operating range of the standard unit's motor. Summary: i) Fan motor kW = 1.1 kW ii) Blower pulley diameter = 150 mm iii) V-belt size = 1440 mm

13 Installation

13 - 2 Pulley

UATYQ250-550BY1


Model	Blower Pulley, Db			Motor Pulley, Dm	
	Type	Diameter (mm)	Bore (mm)	Diameter (mm)	Bore (mm)
UATYQ250BY1	SPZ 1	160	25	71	24
UATYQ350BY1	SPZ 1	160	25	71	24
UATYQ450BY1	SPZ 2	160	25	80	28
UATYQ550BY1	SPZ 2	180	30	95	28
UATYQ600BY1	SPZ 2	180	30	95	28
UATYQ700BY1	SPZ 2	150	30	85	38

Model	V-belt length L (mm)	Pulley Centre Distance, C (mm)	Motor kW	Motor RPM
		Nominal		
UATYQ250BY1	1450	545	1.1	1480
UATYQ350BY1	1600	620	1.5	1520
UATYQ450BY1	1420	590	2.2	1520
UATYQ550BY1	1862	715	3.0	1520
UATYQ600BY1	1900	725	3.7	1500
UATYQ700BY1	1737	670	5.5	1500

14 Operation range

UATYQ-BY1

Ensure the operating temperature is within the allowable range, as stated in diagram below:

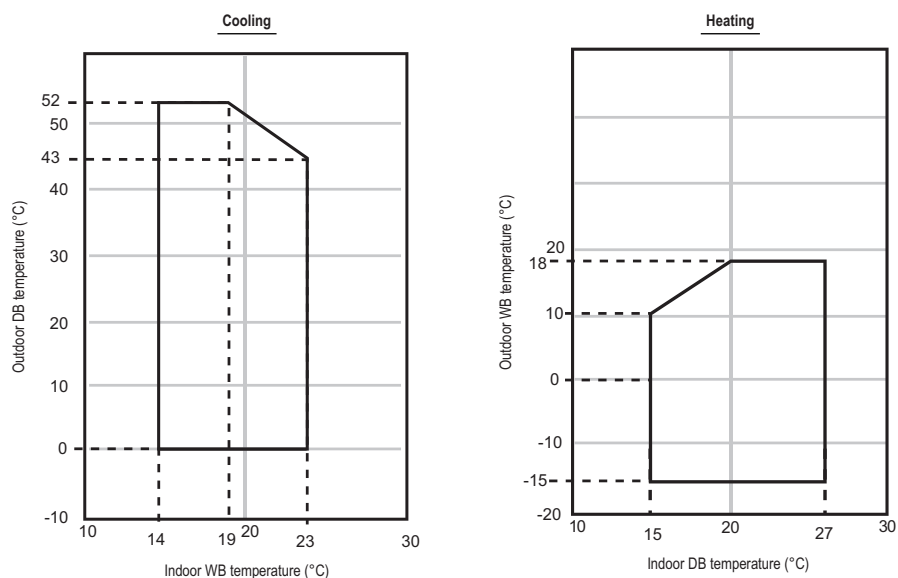

CAUTION

The use of the air conditioner outside the range of working temperature and humidity can result in serious failure.



Daikin's unique position as a manufacturer of air conditioning equipment, compressors and refrigerants has led to its close involvement in environmental issues. For several years Daikin has had the intention to become a leader in the provision of products that have limited impact on the environment. This challenge demands the eco design and development of a wide range of products and an energy management system, resulting in energy conservation and a reduction of waste.



The present publication is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V. Daikin Europe N.V. has compiled the content of this publication to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this publication. All content is copyrighted by Daikin Europe N.V.

Daikin products are distributed by:



Daikin Europe N.V. is participating in the EUROVENT Certification Programme. Products are as listed in the EUROVENT Directory of Certified Products.