



INSTALLATION AND OPERATION MANUAL

VRV System air conditioner

FXYCP20K7V1
FXYCP25K7V1
FXYCP32K7V1
FXYCP40K7V1
FXYCP50K7V1
FXYCP63K7V1
FXYCP80K7V1
FXYCP125K7V1

Daikin Europe N.V.

declares under its sole responsibility that the air conditioning models to which this declaration relates:
erklärt auf seine alleinige Verantwortung daß die Modelle der Klimageräte für die diese Erklärung bestimmt ist:
déclare sous sa seule responsabilité que les appareils d'air conditionné visés par la présente déclaration:

verklaart hierbij op eigen exclusieve verantwoordelijkheid dat de airconditioning units waarop deze verklaring betrekking heeft:
declara baja su única responsabilidad que los modelos de aire acondicionado a los cuales hace referencia la declaración:
dichiara sotto sua responsabilità che i condizionatori modello a cui è riferita questa dichiarazione:

δηλώνει με αποκλειστική της ευθύνη ότι τα μοντέλα των κλιματιστικών συσκευών στα οποία αναφέρεται η παρούσα δήλωση:
declara sob sua exclusiva responsabilidade que os modelos de ar condicionado a que esta declaração se refere:
erklærer under eeneansvar, at klimaanlægmodellerne, som denne deklaration vedrører:

deklarerer i egenskap av huvudansvarig, att luftkonditioneringsmodellerna som berörs av denna deklaration innebär att:
erklærer et fullstendig ansvar for at de luftkondisjoneringsmodeller som berøres av denne deklarasjon innebærer at:
ilmoittaa yksinomaan omalla vastuullaan, että tämän ilmoituksen tarkoitamat ilmastointilaitteiden mallit:

FXYCP20K7V1, FXYCP25K7V1, FXYCP32K7V1,
FXYCP40K7V1, FXYCP50K7V1, FXYCP63K7V1,
FXYCP80K7V1, FXYCP125K7V1

are in conformity with the following standard(s) or other normative document(s), provided that these are used in accordance with our instructions:
der/den folgenden Norm(en) oder einem anderen Normdokument oder -dokumenten entspricht/entsprechen, unter der Voraussetzung, daß sie gemäß unseren Anweisungen eingesetzt werden:
sont conformes à la/aux norme(s) ou autre(s) document(s) normatif(s), pour autant qu'ils soient utilisés conformément à nos instructions:

conform de volgende norm(en) of één of meer andere bindende documenten zijn, op voorwaarde dat ze worden gebruikt overeenkomstig onze instructies:
están en conformidad con la(s) siguiente(s) norma(s) u otro(s) documento(s) normativo(s), siempre que sean utilizados de acuerdo con nuestras instrucciones:
sono conformi al(i) seguente(i) standard(s) o altro(i) documento(i) a carattere normativo, a patto che vengano usati in conformità alle nostre istruzioni:

είναι σύμφωνα με το(α) ακόλουθο(α) πρότυπο(α) ή άλλο έγγραφο(α) κανονισμών, υπό την προϋπόθεση ότι χρησιμοποιούνται σύμφωνα με τις οδηγίες μας:
estão em conformidade com a(s) seguinte(s) norma(s) ou outro(s) documento(s) normativo(s), desde que estes sejam utilizados de acordo com as nossas instruções:
overholder følgende standard(er) eller andet/andre retningsgivende dokument(er), forudsat at disse anvendes i henhold til vore instrukser:

respektive utrustning är utförd i överensstämmelse med och följer följande standard(er) eller andra normgivande dokument, under förutsättning att användning sker i överensstämmelse med våra instruktioner :
respektive utstyr er i overensstemmelse med følgende standard(er) eller andre normgivende dokument(er), under forutsetning av at disse brukes i henhold til våre instrukser:
vastaavat seuraavien standardien ja muiden ohjeellisten dokumenttien vaatimuksia edellyttäen, että niitä käytetään ohjeidemme mukaisesti:

EN60335-2-40,

following the provisions of:
gemäß den Vorschriften der:
conformément aux stipulations des:

overeenkomstig de bepalingen van:
siguiendo las disposiciones de:
secondo le prescrizioni per:

με τήρηση των διατάξεων των:
de acordo com o previsto em:
under iagttagelse af bestemmelserne i:

enligt villkoren i:
gitt i henhold til bestemmelsene i:
noudattaen määräyksiä:

Directives, as amended.
Direktiven, gemäß Änderung.
Directives, telles que modifiées.

Richtlijnen, zoals geamendeerd.
Directivas, según lo enmendado.
Direttive, come da modifica.


Οδηγιών, όπως έχουν τροποποιηθεί.
Directivas, conforme alteração em.
Direktiver, med senere ændringer.

Direktiv, med företagna ändringar.
Direktiver, med foretatte endringer.
Direktivejä, sellaisina kuin ne ovat muutettuina.


Low Voltage 73/23/EEC
Machinery Safety 89/392/EEC
Electromagnetic Compatibility 89/336/EEC *

* Note	as set out in the Technical Construction File DAIKIN.TCF.014 and judged positively by NMI according to the Certificate 9110074503 .
Hinweis	wie in der Technischen Konstruktionsakte DAIKIN.TCF.014 aufgeführt und von NMI positiv ausgezeichnet gemäß Zertifikat 9110074503 .
Remarque	tel que stipulé dans le Fichier de Construction Technique DAIKIN.TCF.014 et jugé positivement par NMI conformément au Certificat 9110074503 .
Bemerk	zoals vermeld in het Technisch Constructiedossier DAIKIN.TCF.014 en in orde bevonden door NMI overeenkomstig Certificaat 9110074503 .
Nota	tal como se expone en el Archivo de Construcción Técnica DAIKIN.TCF.014 y juzgado positivamente por NMI según el Certificado 9110074503 .
Nota	delineato nel File Tecnico di Costruzione DAIKIN.TCF.014 e giudicato positivamente da NMI secondo il Certificato 9110074503 .
Σημείωση	όπως προσδιορίζεται στο Αρχείο Τεχνικής Κατασκευής DAIKIN.TCF.014 και κρίνεται θετικά από το NMI σύμφωνα με το Πιστοποιητικό 9110074503 .
Nota	tal como estabelecido no Ficheiro Técnico de Construção DAIKIN.TCF.014 e com o parecer positivo de NMI de acordo com o Certificado 9110074503 .
Bemærk	som anført i den Tekniske Konstruktionsfil DAIKIN.TCF.014 og positivt vurderet af NMI i henhold til Certifikat 9110074503 .
Information	utrustningen är utförd i enlighet med den Tekniska Konstruktionsfilen DAIKIN.TCF.014 som positivt intygas av NMI vilket också framgår av Certifikat 9110074503 .
Merk	som det fremkommer i den Tekniske Konstruktionsfilen DAIKIN.TCF.014 og gennem positiv bedømmelse af NMI ifølge Certifikat 9110074503 .
Huom	jotka on esitetty Teknisessä Asiakirjassa DAIKIN.TCF.014 ja jotka NMI on hyväksynyt Sertifikaatin 9110074503 mukaisesti.




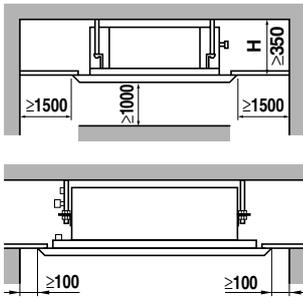


1

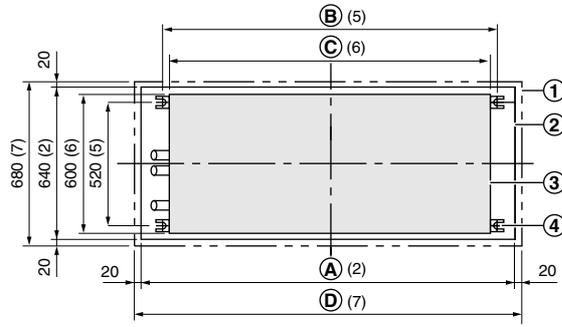


2

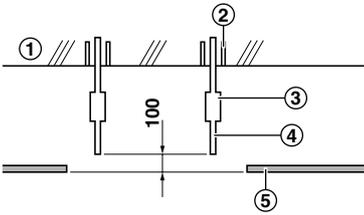


3




4

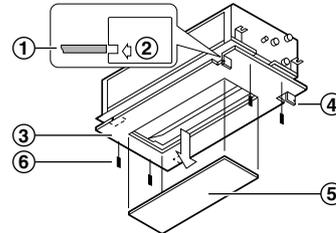


5




6




7

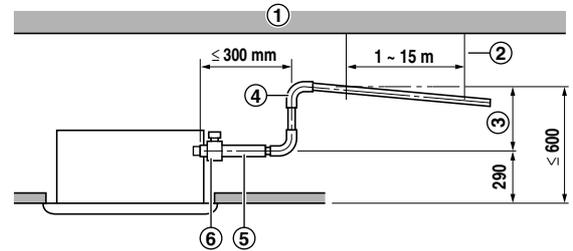


8

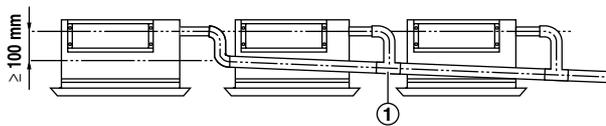


9

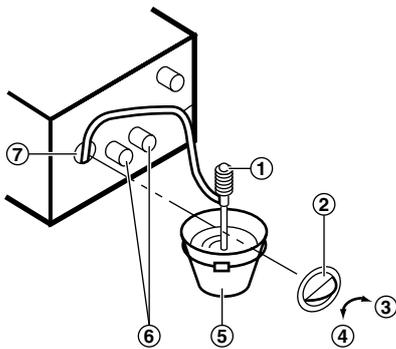


10

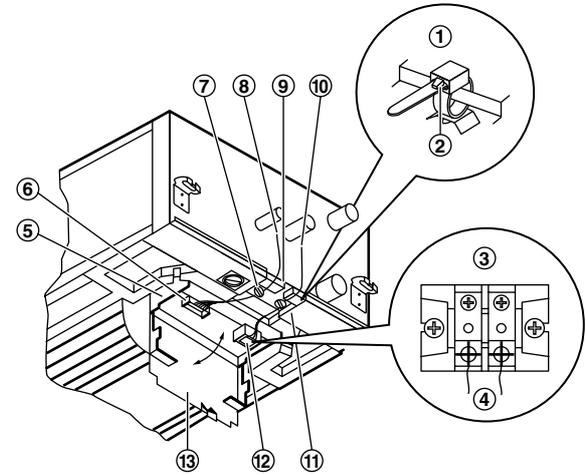


11




12

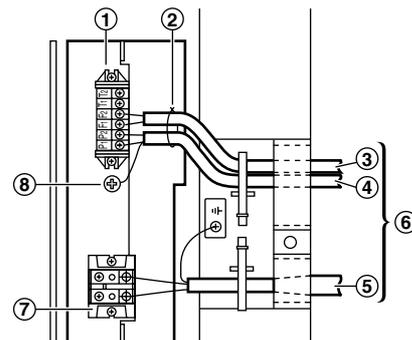


13

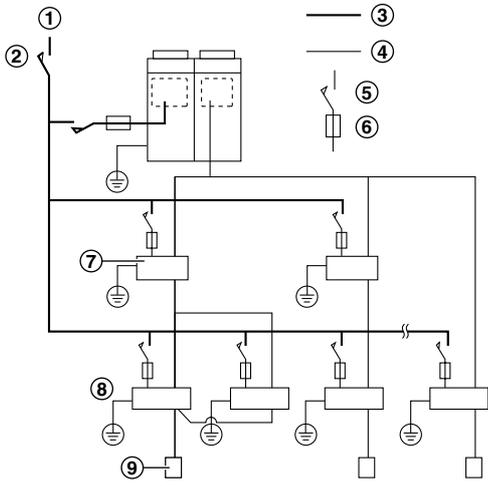


14

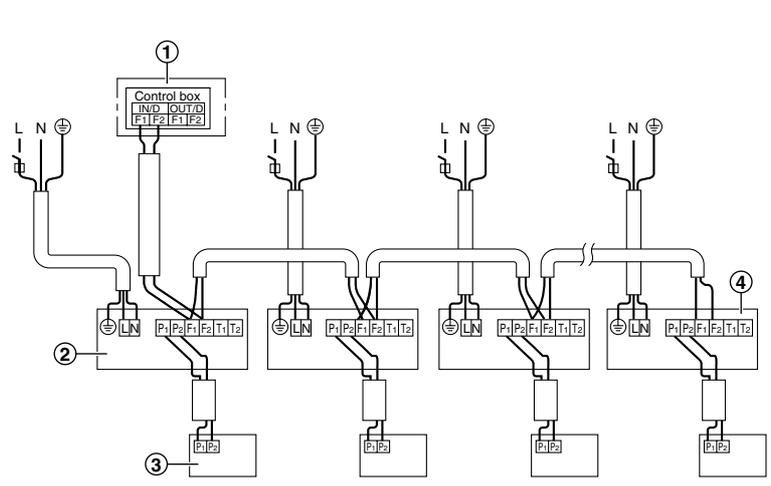


15

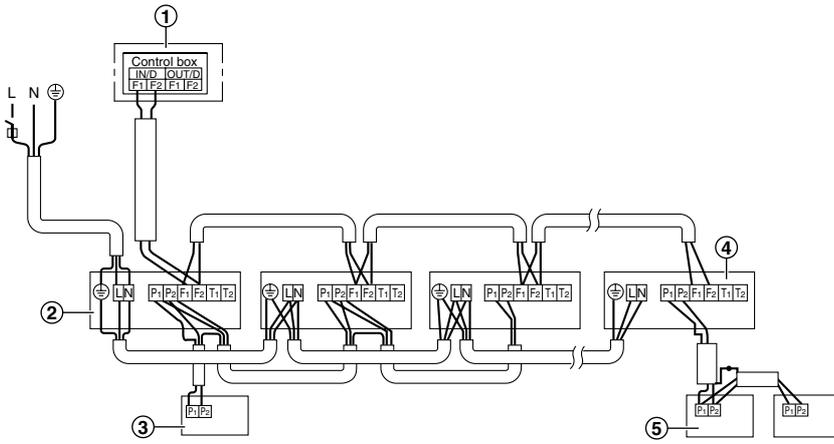


16

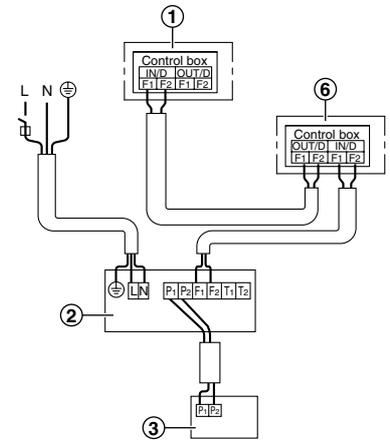


17

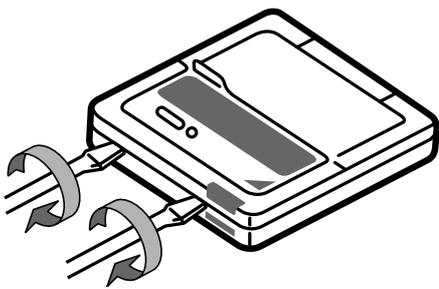


18

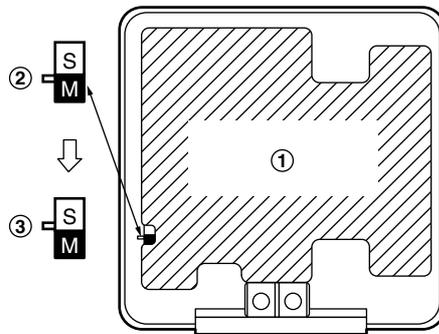

19



20

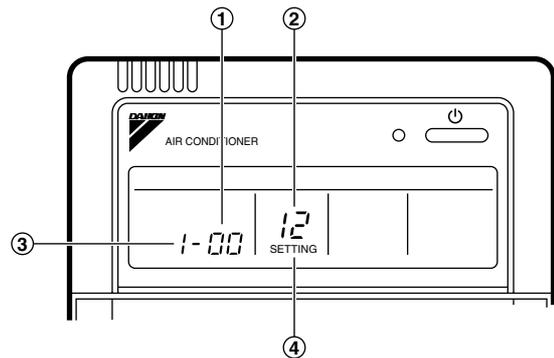

21

page

Before installation	1
Selecting installation site	2
Preparations before installation	2
Indoor unit installation	3
Refrigerant piping work	3
Drain piping work	4
Electric wiring work	5
Wiring example and how to set the remote controller	5
Wiring example	6
Installation of the decoration panel	6
Test operation	6
Maintenance	7



READ THESE INSTRUCTIONS CAREFULLY BEFORE INSTALLATION. KEEP THIS MANUAL IN A HANDY PLACE FOR FUTURE REFERENCE. IMPROPER INSTALLATION OR ATTACHMENT OF EQUIPMENT OR ACCESSORIES COULD RESULT IN ELECTRIC SHOCK, SHORT-CIRCUIT, LEAKS, FIRE OR OTHER DAMAGE TO THE EQUIPMENT. BE SURE ONLY TO USE ACCESSORIES MADE BY DAIKIN WHICH ARE SPECIFICALLY DESIGNED FOR USE WITH THE EQUIPMENT AND HAVE THEM INSTALLED BY A PROFESSIONAL. IF UNSURE OF INSTALLATION PROCEDURES OR USE, ALWAYS CONTACT YOUR DAIKIN DEALER FOR ADVICE AND INFORMATION.

BEFORE INSTALLATION

- Leave the unit inside its packaging until you reach the installation site. Where unpacking is unavoidable, use a sling of soft material or protective plates together with a rope when lifting, this to avoid damage or scratches to the unit.
- Refer to the installation manual of the outdoor unit for items not described in this manual.
- Caution concerning new refrigerant series:
 - The connectable outdoor units must be RSX(Y)P-K or RSEYP-K, the outdoor units designed exclusively for R407C.
 - If outdoor units for R22 are connected, the system will not work properly.

Precautions

- Do not install or operate the unit in rooms mentioned below.
 - Places with mineral oil, or filled with oil vapour or spray like in kitchens. (Plastic parts may deteriorate.)
 - Where corrosive gas like sulphurous gas exists. (Copper tubing and brazed spots may corrode.)
 - Where volatile flammable gas like thinner or gasoline is used.
 - Where machines generating electromagnetic waves exist. (Control system may malfunction.)
 - Where the air contains high levels of salt such as air near the ocean and where voltage fluctuates a lot (e.g. in factories). Also in vehicles or vessels.
- When selecting the installation site, use the supplied paper pattern for installation.

Accessories

Check if the following accessories are included with your unit.

 Clamp 1 pc.	Also used as packing material  Paper pattern for installation 1 pc.	 Drain hose 1 pc.
 Screws M5 For paper pattern for installation 4 pcs.	 Washer for hanging bracket 8 pcs.	Insulation for fitting 1 each  for gas pipe  for liquid pipe
Other: installation and operation manual		

Optional accessories

- There are two types of remote controllers: wired and wireless. Select a remote controller according to customers request and install in an appropriate place. Refer to catalogues and technical literature for selecting a suitable remote controller.
- Decoration panel.

For the following items, take special care during construction and check after installation is finished

Tick when checked

- Is the indoor unit fixed firmly?
The unit may drop, vibrate or make noise.
- Is the gas leak test finished?
It may result in insufficient cooling.
- Is the unit fully insulated?
Condensate water may drip.
- Does drainage flow smoothly?
Condensate water may drip.
- Does the power supply voltage correspond to that shown on the name plate?
The unit may malfunction or components may burn out.
- Are wiring and piping correct?
The unit may malfunction or components may burn out.
- Is the unit safely grounded?
Dangerous at electric leakage.
- Is the wiring size according to specifications?
The unit may malfunction or components may burn out.
- Is nothing blocking the air outlet or inlet of either the indoor or outdoor units?
It may result in insufficient cooling.
- Are refrigerant piping length and additional refrigerant charge noted down?
The refrigerant charge in the system might not be clear.

Notes to the installer

- Read this manual carefully to ensure correct installation. Be sure to instruct the customer how to properly operate the system and show him/her the enclosed operation manual.
- Explain to the customer what system is installed on the site. Be sure to fill out the appropriate installation specifications in the chapter "What to do before operation" of the outdoor unit operation manual.

SELECTING INSTALLATION SITE

- 1. Select an installation site where the following conditions are fulfilled and that meets your customer's approval.**
- Where optimum air distribution can be ensured.
 - Where nothing blocks air passage.
 - Where condensate water can be properly drained.
 - Where the false ceiling is not noticeably on an incline.
 - Where sufficient clearance for maintenance and service can be ensured.
 - Where piping between indoor and outdoor units is possible within the allowable limit. (Refer to the installation manual of the outdoor unit.)
 - Keep indoor unit, outdoor unit, power supply wiring and transmission wiring at least 1 meter away from televisions and radios. This is to prevent image interference and noise in those electrical appliances.
(Noise may be generated depending on the conditions under which the electric wave is generated, even if 1 meter is kept.)

2. Ceiling height

This indoor unit may be installed on ceilings up to 3m in height.

3. Use suspension bolts for installation. Check whether the ceiling is strong enough to support the weight of the indoor unit. If there is a risk, reinforce the ceiling before installing the unit.

(The installation pitch is marked on the paper pattern for installation. Refer to it to check for points requiring reinforcing.)

Space required for installation see figure 1.

PREPARATIONS BEFORE INSTALLATION

1. Relation of ceiling opening to unit and suspension bolt position. (see figure 2)

Model	A	B	C	D
FXYCP20,25,32	990	820	780	1030
FXYCP40,50	1205	1035	995	1245
FXYCP63	1390	1220	1180	1430
FXYCP80,125	1880	1710	1670	1920

- 1 Decoration panel
- 2 Ceiling opening
- 3 Indoor unit
- 4 Suspension bolt (x4)
- 5 Suspension pitch
- 6 Unit outside dimensions
- 7 Panel outside dimensions

2. Make the ceiling opening needed for installation where applicable. (For existing ceilings.)

- Refer to the paper pattern for installation for the ceiling opening dimensions.
- Create the ceiling opening required for installation. From the side of the opening to the casing outlet, implement the refrigerant and drain piping and wiring for remote controller (unnecessary for wireless type) and indoor-outdoor unit casing outlet. Refer to each piping or wiring section.
- After making an opening in the ceiling, it may be necessary to reinforce ceiling beams to keep the ceiling level and to prevent it from vibrating. Consult the builder for details.

3. Install the suspension bolts. (use either a W3/8 or M10 size bolt.)

Use anchors for existing ceilings, and a sunken insert, sunken anchors or other field supplied parts for new ceilings to reinforce the ceiling in order to bear the weight of the unit. Adjust clearance from the ceiling before proceeding further. Installation example see figure 3.

- 1 Ceiling slab
- 2 Anchor
- 3 Long nut or turn-buckle
- 4 Suspension bolt
- 5 False ceiling

NOTE 

- All the above parts are field supplied.
- For other installation than standard installation, contact your Daikin dealer for details.

INDOOR UNIT INSTALLATION

When installing optional accessories (except for the decoration panel), read also the installation manual of the optional accessories. Depending on the field conditions, it may be easier to install optional accessories before the indoor unit is installed. However, for existing ceilings, install fresh air inlet component kit and branch duct before installing the unit.

1. Install the indoor unit temporarily.

- Attach the hanger bracket to the suspension bolt. Be sure to fix it securely by using a nut and washer from the upper and lower sides of the hanger bracket.

Securing the hanger bracket see figure 4.

- 1 Field supplied
- 2 Washer (supplied with the unit)
- 3 Hanger bracket
- 4 Tighten (double nut)

2. Fix the paper pattern for installation. (For new ceilings only.)

- The paper pattern for installation corresponds with the measurements of the ceiling opening. Consult the builder for details.
- The centre of the ceiling opening is indicated on the paper pattern for installation. The centre of the unit is indicated on the label attached to the unit and on the paper pattern for installation.
- After cutting out a slit for the unit in the center of the paper pattern for installation (supplied with the unit), install it with the 4 supplied screws.
- Fold the guide section of the paper pattern for installation and adjust the height of the unit so that the notch in the guide is at the position where you expect the ceiling surface to be. See figure 5.

- 1 Ceiling
- 2 Lower surface of ceiling
- 3 Paper pattern for installation (supplied with the unit)
- 4 Guide section (4 corners)
- 5 Cut-out section
- 6 Screws (x4 supplied with the unit)

3. Adjust the height of the unit. (For existing ceilings only.)

Cut out the guide section of the supplied paper pattern for installation, place on the bottom surface of the unit, and adjust the height of the unit so that the notch of the guide matches the lower surface of the ceiling. See figure 6.

- 1 Ceiling
- 2 Unit body
- 3 Guide portion
- 4 Unit height adjustment
- 5 Lower surface of ceiling

4. Adjust the unit to the right position for installation.

(Refer to the chapter "Preparations before installation")

5. Check if the unit is horizontally levelled.

- Do not install the unit tilted. The indoor unit is equipped with a built-in drain pump and float switch. (If the unit is tilted against condensate flow, the float switch may malfunction and cause water to drip.)
- Check if the unit is levelled at all four corners with a water level or a water-filled vinyl tube as shown in figure 7.

- 1 Water level
- 2 Vinyl tube

6. Remove the paper pattern for installation (For new ceilings only.)

REFRIGERANT PIPING WORK

For refrigerant piping of outdoor unit, refer to the installation manual supplied with the outdoor unit.


Before rigging tubes, check which type of refrigerant is used. (This unit uses R407C.)



All field piping must be provided by a licensed refrigeration technician and must comply with the relevant local and national codes.


- Use a pipe cutter and flare suitable for R407C.
- Apply ether oil or ester oil around the flare portions before connecting.
- To prevent dust, moisture or other foreign matter from infiltrating the tube, either pinch the end, or cover it with tape.
- The outdoor unit is charged with refrigerant.
- Be sure to use both a spanner and torque wrench together when connecting or disconnecting pipes to/from the unit.

- 1 Torque wrench
- 2 Spanner
- 3 Piping union
- 4 Flare nut

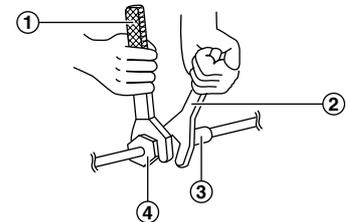


- Do not mix anything other than the specified refrigerant, such as air, etc., inside the refrigerant circuit.
- Refer to Table 1 for the dimensions of flare nut spaces and the appropriate tightening torque. (Overtightening may damage the flare and cause leaks.)
- When connecting the flare nut, coat the flare both inside and outside with ether oil or ester oil and initially tighten by hand 3 or 4 turns before tightening firmly.

- 1 Coat here with ether oil or ester oil

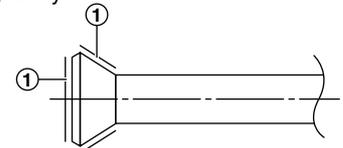


- Check the pipe connector for gas leaks.

- 1 Liquid pipe
- 2 Gas pipe
- 3 Insulation for fitting of liquid line (supplied with the unit)
- 4 Insulation for fitting of gas line (supplied with the unit)
- 5 Clamps (use 2 clamps per insulation)




- If the refrigerant gas leaks during the work, ventilate the area. A toxic gas is emitted by the refrigerant gas being exposed to a fire.
- Finally make sure there is no refrigerant gas leak. A toxic gas may be released by the refrigerant gas leaking indoor and being exposed to flames from an area heater, cooking stove, etc...

Table 1

Pipe gauge	Tightening torque	Flare dimension A (mm)	Flare shape
Ø 6.4	1420~1720N•cm (144~176kgf•cm)	8.3~8.7	
Ø 9.5	3270~3990N•cm (333~407kgf•cm)	12.0~12.4	
Ø 12.7	4950~6030N•cm (504~616kgf•cm)	15.4~15.8	
Ø 15.9	6180~7540N•cm (630~770kgf•cm)	18.6~19.0	
Ø 19.1	9720~11860N•cm (990~1210kgf•cm)	22.9~23.3	

DRAIN PIPING WORK

Rig the drain piping as shown in figure and take measures against condensation. Improperly rigged piping could lead to leaks and eventually wet furniture and belongings.

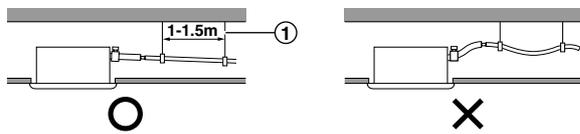


- 1 Hanging bar

1. Install the drain pipes.

- Keep piping as short as possible and slope it downwards so that air may not remain trapped inside the pipe.
- Keep pipe size equal to or greater than that of the connecting pipe (Vinyl pipe of 25mm nominal diameter and 32mm outer diameter).
- Insert the supplied drain hose into the drain socket, up to the white tape.
- Tighten the clamp until the screw head is less than 4mm from the hose.

- 1 Clamp metal
2 Drain hose
3 White tape (field supply)



- Insulate the drain hose inside the building.
- If the drain hose cannot be sufficiently set on a slope, fit the hose with drain raising piping (field supply).

HOW TO PERFORM PIPING (see figure 8)

- Ceiling slab
 - Hanger bracket
 - Adjustable (310 or less)
 - Drain raising pipe
 - Drain hose (supplied with the unit)
 - Clamp metal (supplied with the unit)
- Connect the drain hose to the drain raising pipes, and insulate them.
 - Connect the drain hose to the drain outlet on the indoor unit, and tighten it with the clamp.

PRECAUTIONS

- Install the drain raising pipes at a height of less than 310mm.
- Install the drain raising pipes at a right angle to the indoor unit and no more than 300mm from the unit.

NOTE

- The incline of attached drain hose should be 75mm or less so that the drain socket does not have to stand additional force.
- To ensure a downward slope of 1:100, install hanging bars every 1 to 1.5m.
- If unifying multiple drain pipes, install the pipes as shown in figure 9. Select converging drain pipes whose gauge is suitable for the operating capacity of the unit.

- 1 T-joint converging drain pipes

2. After piping work is finished, check if drainage flows smoothly.

- Open the water inlet lid, add approximately 2.5l of water gradually and check the drainage flow.

Method of adding water. See figure 10.

- Portable pump
- Water inlet lid
- Close
- Open
- Bucket
- Refrigerant piping
- Water inlet

- If adding water from the charge inlet at the fan casing, be sure to put the lid back in its original position.

WHEN ELECTRIC WIRING WORK IS FINISHED

Check drainage flow during COOL running, explained in chapter "TEST OPERATION".

WHEN ELECTRIC WIRING WORK IS NOT FINISHED

- Remove the switch box lid and connect the power supply and remote controller to the terminals.

See figure 11.

- Clamps A and B details
- Clip
- Terminal board
- 220V-240V single phase power supply
- Electric parts box
- Terminal board for transmission wiring
- Clamp B
- Transmission wiring
- Guide plate
- Power supply wiring
- Clamp A
- Terminal board for power supply
- Electric parts box lid

- Next, press the inspection/test operation button  on the remote controller. The unit will engage the test operation mode. Press the operation mode selector button  until selecting fan operation . Then, press the on/off button . The indoor unit fan and drain pump will start up. Check that the water has drained from the unit. Press  to go back to the first mode.
- You can check whether drainage is satisfactory or not by removing the access opening lid and checking the water level of the drain pan through the access opening. **Be careful when doing so because the fan is turning at the same time.** See figure 12.
 - Access opening
 - Access opening lid
 - Close
 - Open

ELECTRIC WIRING WORK

General instructions

- All field supplied parts and materials and electric works must conform to local codes.
- Use copper wire only.
- Follow the "Wiring diagram" attached to the unit body to wire the outdoor unit, indoor units and the remote controller. For details on hooking up the remote controller, refer to the "Installation manual of the remote controller".
- All wiring must be performed by an authorized electrician.
- A circuit breaker capable of shutting down power supply to the entire system must be installed.
- This system consists of multiple indoor units. Mark each indoor unit as unit A, unit B..., and be sure the terminal board wiring to the outdoor unit and BS unit are properly matched. If wiring and piping between the outdoor unit and an indoor unit are mismatched, the system may cause a malfunction.

Electrical characteristics

Model	Hz	Volts	Voltage range
FXYCP20~125	50	230	min.198-max.264

	power supply		Fan motor	
	MCA	MFA	KW	FLA
FXYCP20	0.5	16A	0.010	0.4
FXYCP25•32	0.5	16A	0.015	0.4
FXYCP40•50	0.8	16A	0.020	0.6
FXYCP63	0.9	16A	0.030	0.7
FXYCP80	1.1	16A	0.050	0.9
FXYCP125	1.3	16A	0.085	1.0

MCA: Min. circuit Amps (A)
MFA: Max. Fuse Amps (A)
KW: Fan Motor Rated Output (kW)
FLA: Full Load Amps (A)

NOTE

- For details, refer to "Electrical data".

Specifications for field supplied fuses and wire

Model	Power supply wiring		
	Field fuses	Wire	Size
FXYCP20~125	16A	H05VV-U3G	Local codes

Model	Transmission wire	
	Wire	Size
FXYCP20~125	Sheathed wire (2)	0.75-1.25mm ²

NOTE

- For details, refer to the chapter "Wiring example".
- Allowable length of transmission wiring between indoor and outdoor units, and between the indoor unit and the remote controller is as follows:
 - 1 Outdoor unit - indoor unit: max. 1000m (total wiring length: 2000m)
 - 2 Indoor unit - remote controller: max 500m

WIRING EXAMPLE AND HOW TO SET THE REMOTE CONTROLLER

How to connect wiring (see figure 11)

- Power supply wiring
Remove the switch box lid (1) and connect the wires to the power supply terminal board inside. While doing this, pull the wires inside through the rubber bush A and clamp the wires along with other wires using clamp A, untightening the clip of clamp A by pressing. After the connection, tighten clamp A as before.
- Unit wiring and remote controller wiring
Remove the switch box lid (2) and pull the wires inside through the rubber bush B and connect to the terminal board for unit transmission wiring.

PRECAUTIONS (see figure 13)

- 1 Terminal board for unit transmission wirings
- 2 Clamp
- 3 Transmission wiring between units
- 4 Remote controller wiring
- 5 Power supply wiring
- 6 Field supplied wires
- 7 Power supply terminal board
- 8 Earth terminal (supplied with the unit)

- 1 Observe the notes mentioned below when wiring to the power supply terminal board.
 - Do not connect wires of different gauge to the same power supply terminal. (Looseness in the connection may cause overheating.)
 - When connecting wires of the same gauge, connect them according to the figure.



- 2 Keep total current of crossover wiring between indoor units less than 12A. Branch the line outside the terminal board of the unit in accordance with electrical equipment standards, when using two power wiring of a gauge greater than 2mm² (Ø1.6).
The branch must be sheathed in order to provide an equal or greater degree of insulation as power supply wiring itself.
- 3 Do not connect wires of different gauge to the same grounding terminal. Looseness in the connection may deteriorate the protection.
- 4 Remote controller cords and wires connecting the units should be located at least 50mm away from power supply wiring. Not following this guideline may result in malfunction due to electrical noise.
- 5 For the remote controller wiring, refer to the "Installation manual of the remote controller" supplied with the remote controller.
- 6 Never connect the power supply wiring to the terminal board for transmission wiring. This mistake could damage the entire system.
- 7 Use only specified wires and tightly connect wires to the terminals. Be careful that wires do not place external stress on the terminals. Keep wiring in neat order so that they do not obstruct other equipment such as popping open the service cover. Make sure the cover closes tight. Incomplete connections could result in overheating, and in the worse case, electric shock or fire.

WIRING EXAMPLE

- Fit the power supply wiring of each unit with a switch and fuse as shown in figure 14.
 - Power supply
 - Main switch
 - Power supply wiring
 - Transmission wiring
 - Switch
 - Fuse
 - BS unit RSEYP only
 - Indoor unit
 - Remote controller

COMPLETE SYSTEM EXAMPLE (3 systems)

When using 1 remote controller for 1 indoor unit. (Normal operation.) (see figure 15).

For group control or use with 2 remote controllers (see figure 16).

When including BS unit (see figure 17).

- Outdoor unit
- Indoor unit
- Remote controller (Optional accessories)
- Most downstream indoor unit
- For use with 2 remote controllers
- BS unit

NOTE

- It is not necessary to designate indoor unit address when using group control. The address is automatically set when the power is activated.

PRECAUTIONS

- A single switch can be used to supply power to units on the same system. However, branch switches and branch circuit breakers must be selected carefully.
- For a group control remote controller, choose the remote controller that suits the indoor unit which has the most functions.
- Do not ground the equipment on gas pipes, water pipes, lightning rods or crossground with telephones. Improper grounding could result in electric shock.

Control by 2 Remote Controllers (Controlling 1 indoor unit by 2 remote controllers)

- When using 2 remote controllers, one must be set to "MAIN" and the other to "SUB".

MAIN/SUB CHANGEOVER

- Insert a wedge-head screwdriver into the recess between the upper and lower part of the remote controller and, working from the 2 positions, pry off the upper part. (see figure 18) (The remote controller PC board is attached to the upper part of the remote controller.)
- Turn the main/sub changeover switch on one of the two remote controller PC boards to "S". (see figure 19) (Leave the switch of the other remote controller set to "M".)
 - Remote controller PC board
 - Factory setting
 - Only one remote controller needs to be changed

Computerised control (forced off and on/off operation)

- Wire specifications and how to perform wiring.
 - Connect input from outside to terminals T1 and T2 of the terminal board (remote controller to transmission wiring).

Wire specification	Sheathed vinyl cord or cable (2 wire)
Gauge	0.75-1.25mm ²
Length	Max. 100m
External terminal	Contact that can ensure the minimum applicable load of 15V DC, 10mA

See figure 20

- Input A
- Actuation
 - The following table explains "forced off" and "on/off operations" in response to input A.

Forced off	on/off operation
Input "on" stops operation	input off → on: turns on the unit (impossible by remote controllers)
Input "off" enables control	input on → off: turns off the unit (by remote controller)

- How to select forced off and on/off operation
 - Turn the power on and then use the remote controller to select operation.
 - Set the remote controller to the field set mode. For details, refer to the chapter "How to set in the field", in the remote controller manual.
 - When in the field set mode, select mode No. 12, then set the first code (switch) No. to '1'. Then set second code (position) No. to '01' for forced off and to '02' for on/off operation. (forced off at factory set.) (see figure 21)
 - Second code No.
 - Mode No.
 - First code No.
 - Field set mode

Centralized control

- For centralized control, it is necessary to designate the group No. For details, refer to the manual of each optional controller for centralized control.

INSTALLATION OF THE DECORATION PANEL

Refer to the installation manual attached to the decoration panel.

After installing the decoration panel, ensure that there is no space between the unit body and decoration panel.


TEST OPERATION

Refer to the installation manual of the outdoor unit.

- The operation lamp of the remote controller will flash when an error occurs. Check the error code on the liquid crystal display to identify the trouble. An explanation of error codes and the corresponding trouble is provided on "Caution for servicing" sticker on the indoor units switch box.

PRECAUTIONS

In case something is wrong with the unit and it does not operate, refer to the malfunction diagnosis label attached to the unit.

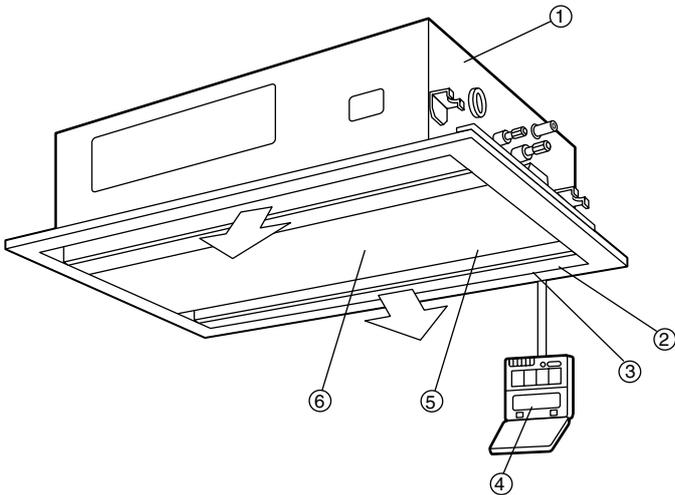

- 1 Drain pumping device (built-in) drain water is removed from the room during cooling
- 2 Air flow flap (at air outlet)
- 3 Air outlet
- 4 Remote controller
- 5 Air inlet
- 6 Air filter (inside suction grill)

MAINTENANCE

IMPORTANT

- ONLY A QUALIFIED SERVICE PERSON IS ALLOWED TO PERFORM MAINTENANCE.
- BEFORE OBTAINING ACCESS TO TERMINAL DEVICES, ALL POWER SUPPLY CIRCUITS MUST BE INTERRUPTED.
- DO NOT USE WATER OR AIR OF 50°C OR HIGHER FOR CLEANING AIR FILTERS AND OUTSIDE PANELS.

HOW TO CLEAN THE AIR FILTER


Clean the air filter when the display shows "  " (TIME TO CLEAN AIR FILTER).

Increase the frequency of cleaning if the unit is installed in a room where the air is extremely contaminated.

(As a yardstick for yourself, consider cleaning the filter once a half year.)

If dirt becomes impossible to clean, change the air filter. (Air filter for exchange is optional.)


1. Open the suction grill.
Grip the suction grill on one side, and open by pulling toward yourself while holding it up.

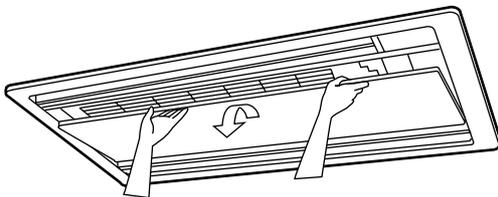

NOTE

- Do not let go of the suction grill when opening or closing it. If released, the grill will spring back closed.

2. Remove the air filters.
Push the air filters operation section with both hands in the direction indicated by the arrow, undo the air filter clips, and take out downward.

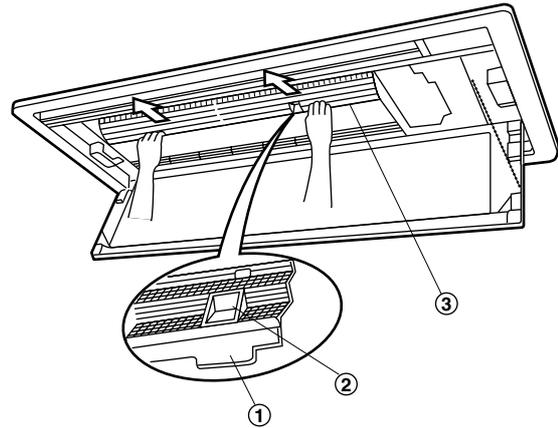


- 1 Clip
- 2 Operation section
- 3 Air filter

3. Clean the air filter.
Use a vacuum cleaner or wash the air filter with water. When the air filter is very dirty, use a soft brush and neutral detergent.



4. Fix the air filter.
With the air filters arrow direction facing upward, push up along the guide.
Replace the air filter by performing the filter removal procedure in reverse.

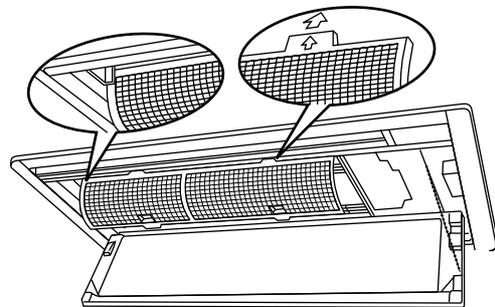

5. Shut the air inlet grill.
Refer to item No. 1.
6. After turning power on, press the FILTER SIGN RESET button.
The "TIME TO CLEAN AIR FILTER" display disappears.
(For details, refer to the operation manual of the outdoor unit.)

NOTE

- Do not remove the air filter except when cleaning. Unnecessary handling may damage the filter.

DAIKIN EUROPE NV

Zandvoordestraat 300, B-8400 Oostende, Belgium

4PWE09081-1